

DCM 2 Series Controller Quick Start Guide


CAUTION

Before attempting calibration or commissioning of the DCM2 controller, water chemistry must be stable and within normal ranges of 7.2-7.8 pH, Total Alkalinity 80-120 ppm, Free Chlorine 1-2 ppm

pH Calibration

1. Perform a pH test and NOTE the results

2. Press  2 times [pH Sensor]

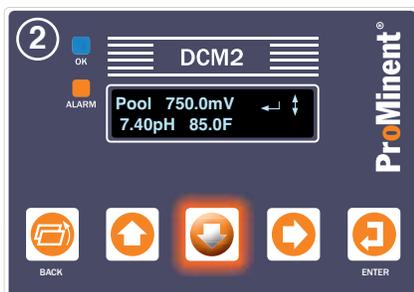

3. Press  3 times [Editing,  or Exit]



4. Press    to adjust displayed value to match the tested value, then press  to accept the change



5. Press  to return to the main status screen



(Temperature Calibration is performed in the same manner from the Temperature Sensor menu, and field ORP calibrations are not needed)

Adjusting Pump Setpoints

Note: The pH Turn OFF setpoint is determined by the deadband value subtracted from the Turn ON setpoint. The Turn OFF setpoint is the ideal control setting value where feed is no longer needed

1. Press  3 times [pool Oxidant] [pH Sensor] [Acid Pump]



2. Press  3 times to change the Turn ON setpoint [Editing,  or Exit]



3. Press    to adjust the Turn ON setpoint, usually one or two units above the Turn OFF setpoint for acid feed systems. Then press  to accept the new value



4. Press  then  to change the deadband value (Turn ON - Turn OFF) pH default is 0.10 pH, ORP is 10.0 mV, ppm is 0.5 ppm



5. Press   to adjust the deadband value. This is the value that defines when the feeder stops and is calculated by subtracting the desired off point from the Turn ON setpoint. Then press  to accept the new value.

6. Pressing  BACK returns to the main status screen

DCM 2 Series Controller

Quick Start Guide

Alarm Information

If the orange ALARM light is flashing, an alarm has activated.

1. Press  once to view active alarms. The LCD screen will alternately show the oxidant feeder status along with any inputs (letter) or outputs (numbers) that have alarmed.




Note: Alarms may have been corrected and the alarm just may need to be acknowledged.



Clear (Reset) All Alarms

1. When the alarm light is flashing and you just want to acknowledge and clear the alarms, press  then  twice.
[Alarm Status Screen]
[Alarm Menus]
[Clear Alarms]

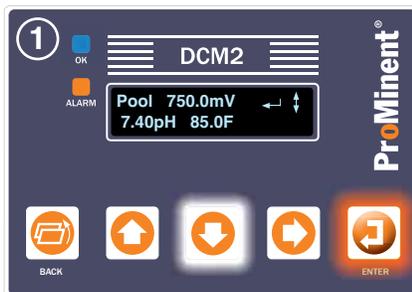

Changing a Pump/Feeder Auto to Off - Manual ON

Relays 1 and 2 are factory set as Acid Pump and Oxidant Pump, using pH Sensor A, and ORP Sensor B, respectively. They are default in the AUTO mode for ON/OFF control to 7.4 pH and 750mV. They can be set to the on mode for priming or to the OFF mode to temporarily disable chemical feed.

1. Choose the relay you want to change by pressing  the button until the selected (relay 1 or 2) is shown.



2. Press and hold the  button and the display will change to show ←AUTO ↓OFF ↑ON while the  button is held down.



3. While holding the  button, pressing one of the three other buttons , , or  will put the output in that respective mode.



The default timeout for the forced ON condition is 10 minutes. After that delay, the relay will revert to AUTO mode. To adjust this time, refer to the install manual or ask your ProMinent Distributor for assistance.

ProMinent Fluid Controls, Inc.

136 Industry Drive • Pittsburgh, Pa 15275
Ph: 412-787-2484 • Fx: 412-787-0704

eMail: sales@prominent.us
www.prominent.us