

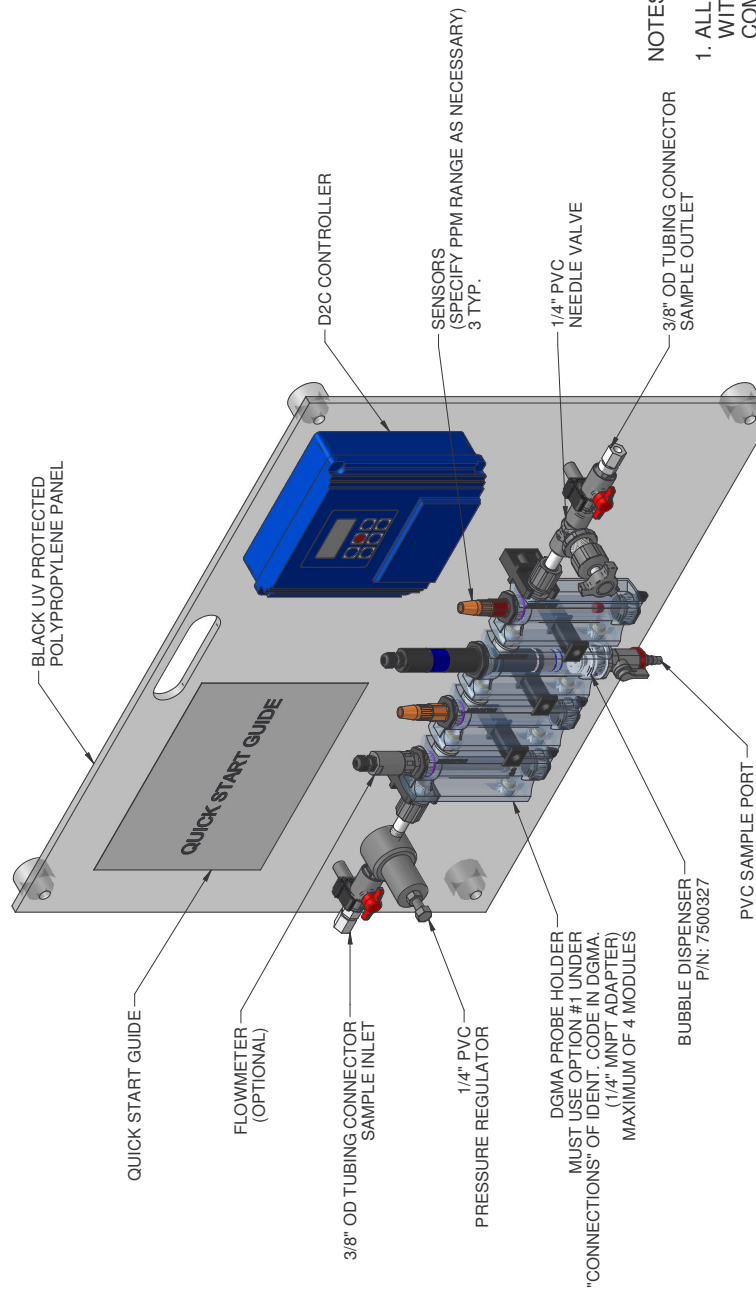
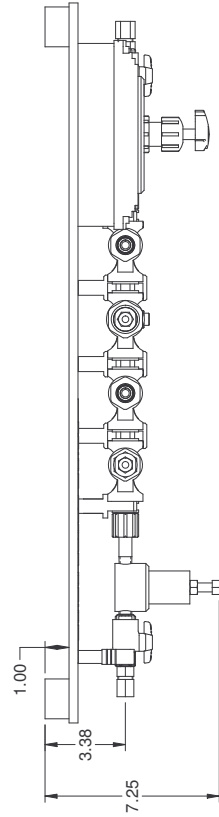


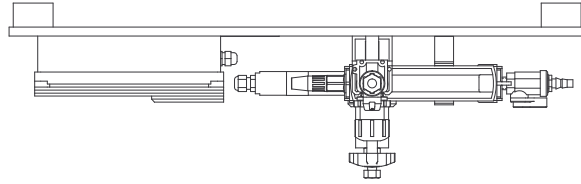

ISOMETRIC VIEW

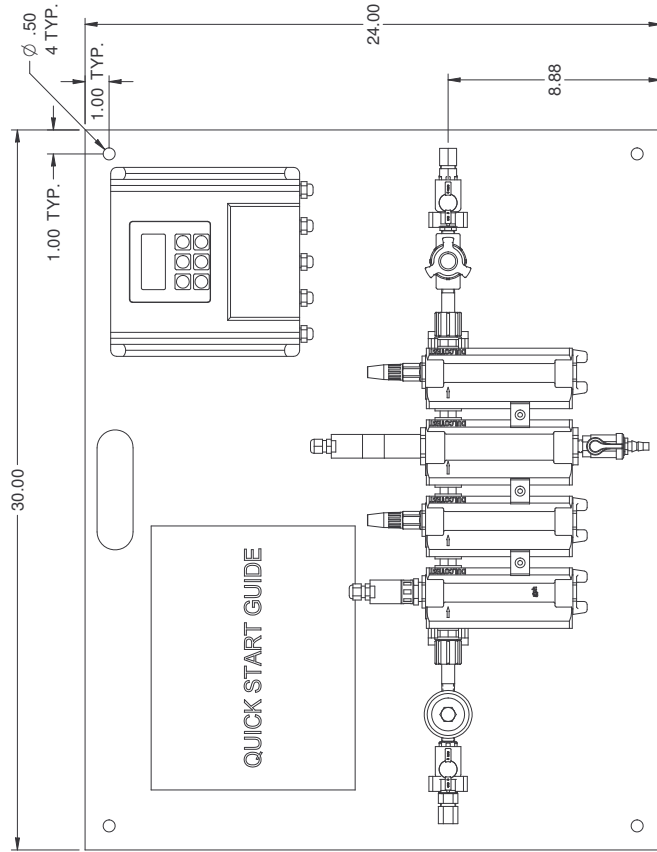

SIDE VIEW

FRONT VIEW

NOTES:

1. ALL PIPING AND FITTINGS SHALL BE 1/4" SCH. 80 PVC SOCKET WELD WITH VITON SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
2. INLET AND OUTLET SHALL BE 3/8" TUBE FITTING. QTY. OF 30 FT. OF 3/8" PE TUBING TO SHIP LOOSE WITH PANEL.
3. SENSORS, DGMA & D2C TO BE ORDERED SEPERATELY.
4. QUANTITY OF (1) pH 7, 50 mL, BUFFER SOLUTION, P/N: 506253, AND (1) pH 10, 50 mL, BUFFER SOLUTION, P/N: 506255 TO SHIP LOOSE WITH PANEL.
5. ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

F	06/08/10	UPDATED BACK PANEL				JDB				
REV	DATE	DESCRIPTION				BY	APPD	REVD		
REVISIONS										
CUSTOMER		PROMINENT FLUID CONTROLS INC. (STANDARD CONTROL PACKAGE)								
JOB No		7744851		PURCHASE ORDER No		N/A				
TITLE		D2C PACKAGE W/ NEEDLE VALVE & PR GENERAL ARRANGEMENT								
THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.										
ENGINEERS SEAL		 ProMinent® THE PROMINENT GROUP OF COMPANIES								
		PITTSBURGH, PA USA		WWW.PROMINENT.US						
		PROMINENT FLUID CONTROLS LTD.		PROMINENT FLUID CONTROLS INC.						
		490 SOUTHGATE DRIVE.		RIDC PARK WEST						
		GUELPH, ONTARIO, CANADA		136 INDUSTRY DRIVE.						
		N1H 6J3		PITTSBURGH P.A., USA. 15275						
		TEL. 519 836 5692		FAX 519 836 5226		APPROVED		TEL. 412 787 2484 FAX. 412 787 0704		
		DESIGNED		CLW		CLW		SCALE		N.T.S.
DRAWN		CLW				DATE		01-29-02		
CHECKED		JMS				REV		F		PAGE 1/1
DWG No		7744851-200								