




PLAN VIEW

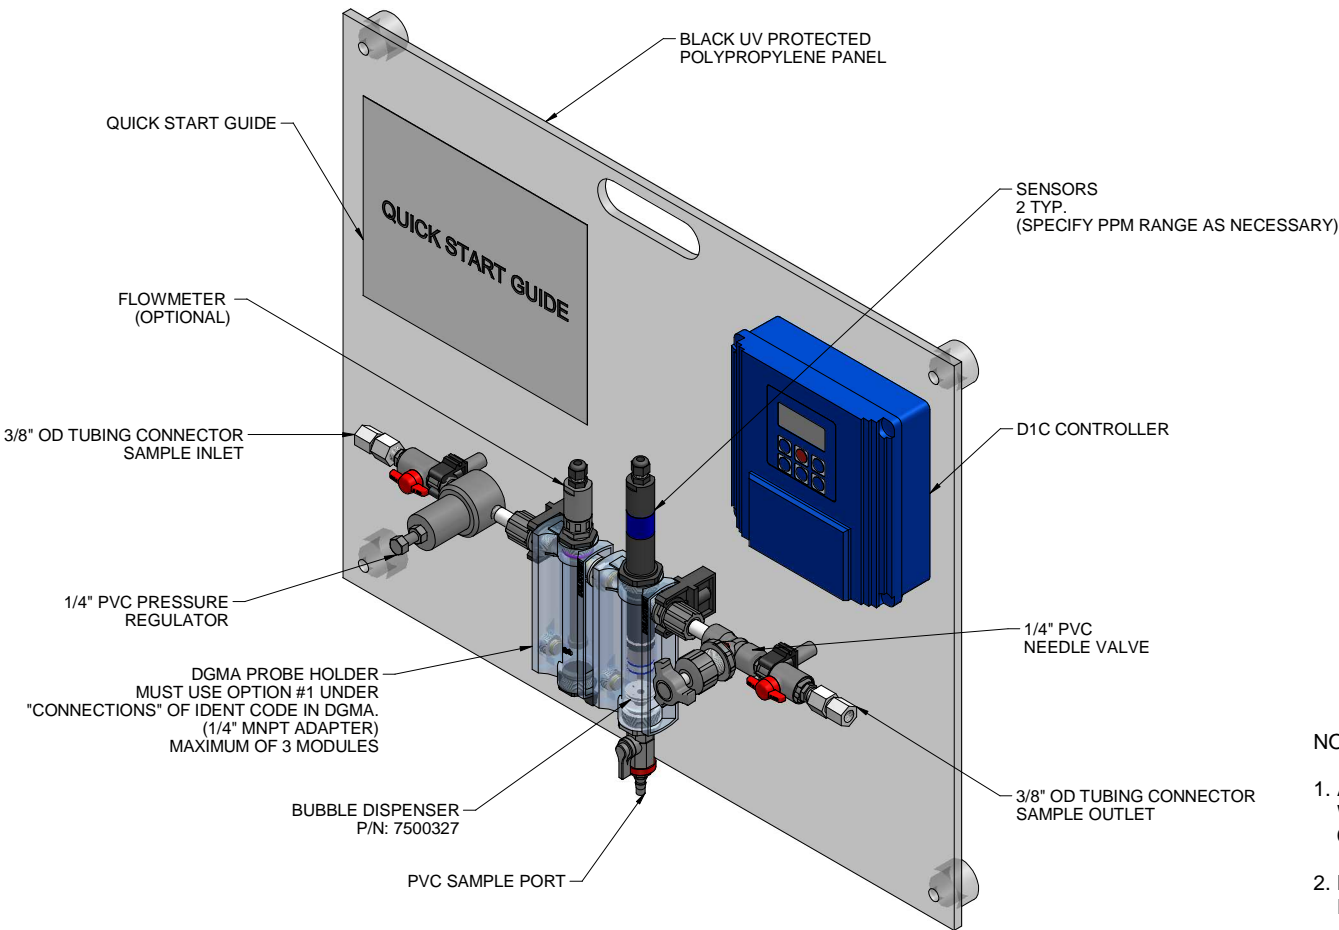

ISOMETRIC VIEW

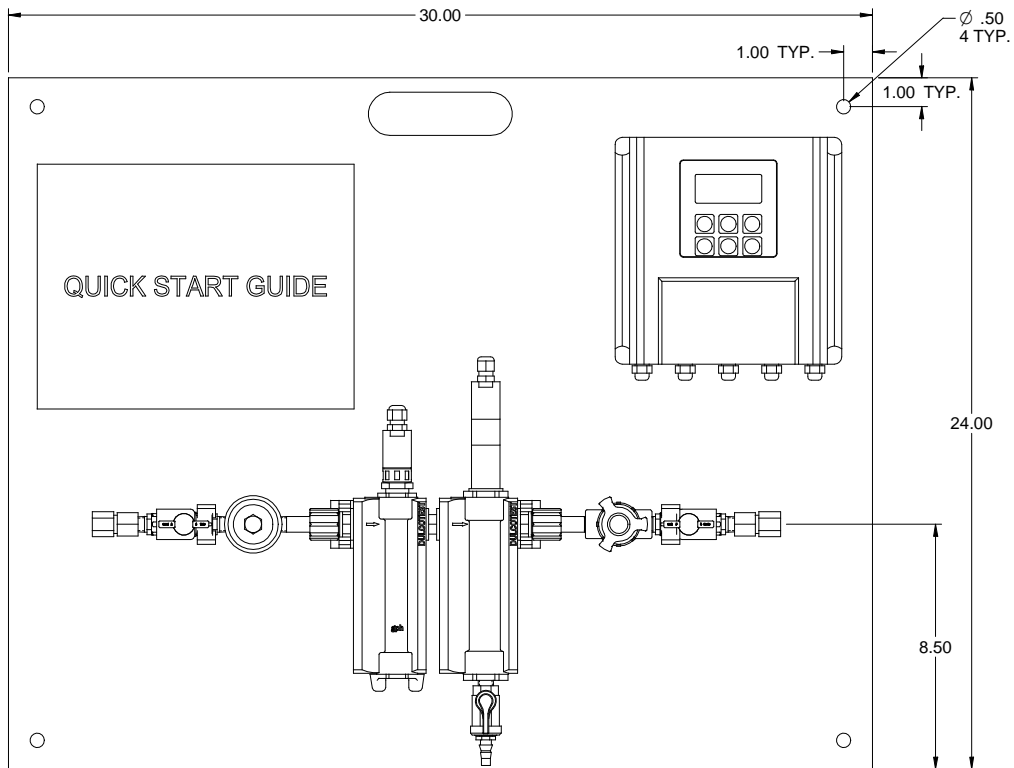

FRONT VIEW

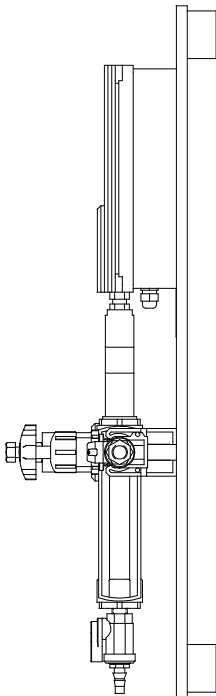

SIDE VIEW

- NOTES:
- ALL PIPING AND FITTINGS SHALL BE 1/4" SCH. 80 PVC SOCKET WELD WITH VITON SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
 - INLET AND OUTLET SHALL BE 3/8" TUBE FITTING. QTY. 30 FT. OF 3/8" PE TUBING TO SHIP LOOSE WITH PANEL.
 - SENSORS, DGMA & D1C TO BE ORDERED SEPERATELY.
 - ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

E	06/08/10	UPDATED BACK PANEL		JDB		
D	12/09/09	REMOVED TEXT		ALS		
C	10/15/09	REPLACE BALL VALVES WITH SPEARS		ALS		
REV	DATE	DESCRIPTION		BY	APPD/REVD	
REVISIONS						
CUSTOMER		PROMINENT FLUID CONTROLS INC. (STANDARD CONTROL PACKAGE)				
JOB No		7744852		PURCHASE ORDER No		N/A
TITLE		D1C PACKAGE W/ NEEDLE VALVE & PR GENERAL ARRANGEMENT				
THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.						
ENGINEERS SEAL		<div><div><div><div>pfc</div><div>ProMinent</div></div><div><div>ProMinent®</div><div>THE PROMINENT GROUP OF COMPANIES</div></div></div></div>				
		PITTSBURGH, PA USA		WWW.PROMINENT.US		
		PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692 FAX. 519 836 5226		PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484 FAX. 412 787 0704		
		DESIGNED CLW		APPROVED		
		DRAWN CLW		SCALE N.T.S.		
		CHECKED JMS		DATE 08/05/02		
DWG No				REV		PAGE
7744852-200				E		1/1