




PLAN VIEW

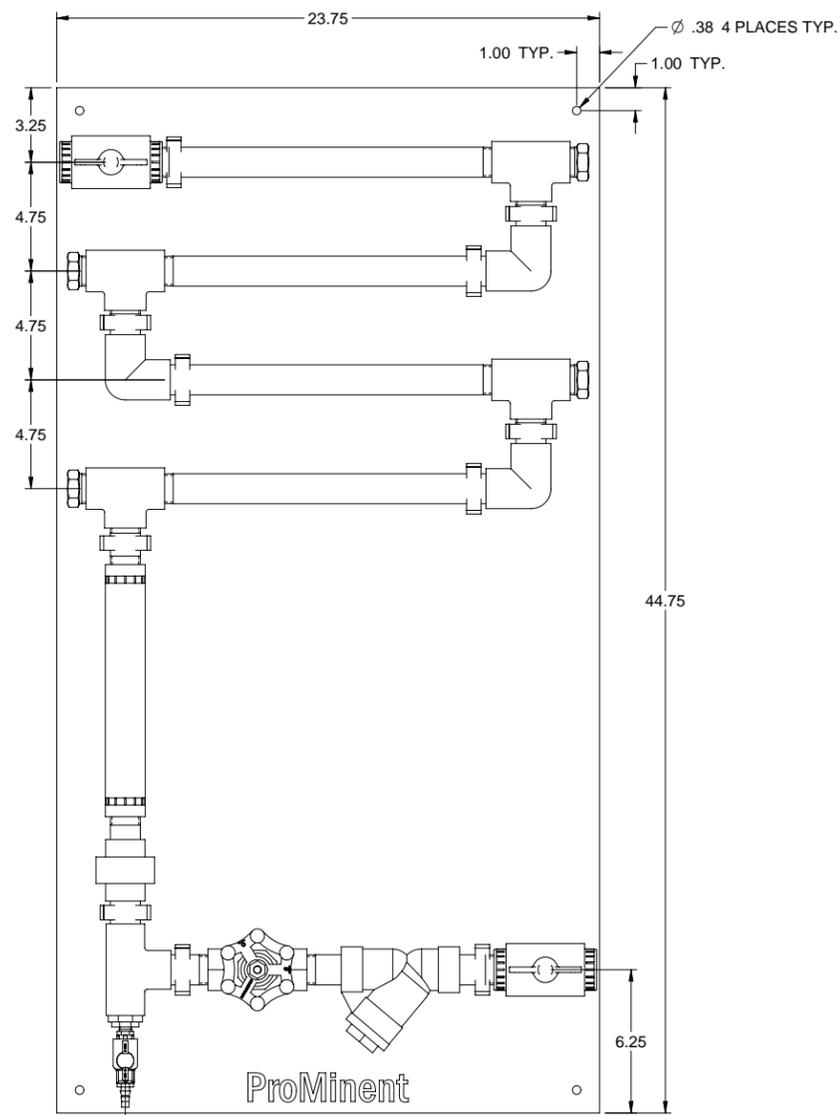

FRONT VIEW

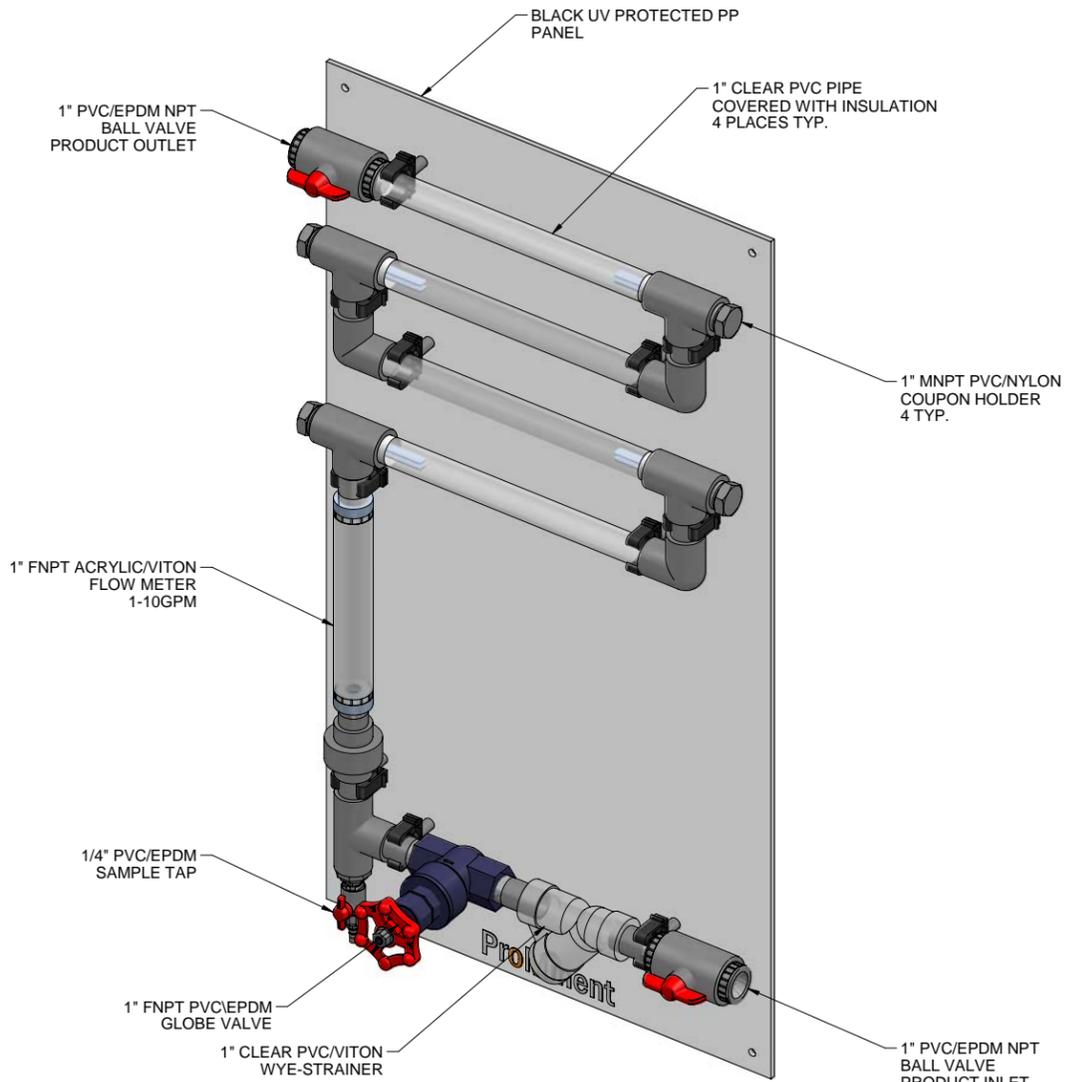

ISOMETRIC VIEW

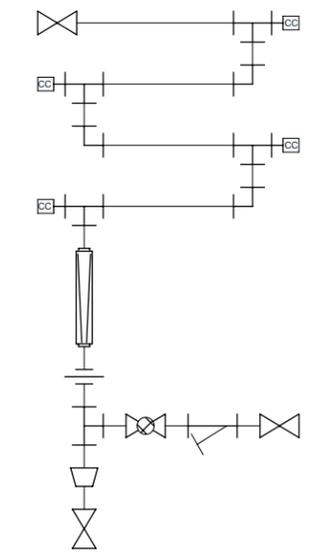

PIPING SCHEMATIC

NOTES:

1. ALL PIPING AND FITTINGS SHALL BE 1" SCH. 80 PVC SOCKET WELD WITH EPDM SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
2. COUPONS ARE NOT INCLUDED.
3. ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

REV	DATE	DESCRIPTION	BY	APPD	REVD
0	09/23/09	FIRST ISSUE	GJS		

CUSTOMER PROMINENT FLUID CONTROLS INC. (STANDARD COUPON RACKS)	
JOB No 7746435	PURCHASE ORDER No N/A
TITLE 4 COUPON RACK 1" PVC OPTION 2 ROTOMETER GENERAL ARRANGEMENT	

THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.

ENGINEERS SEAL			
	PITTSBURGH, PA USA WWW.PROMINENT.US		
PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692 FAX. 519 836 5226		PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484 FAX. 412 787 0704	
DESIGNED	GJS	APPROVED	
DRAWN	GJS	SCALE	N.T.S.
CHECKED	JMS	DATE	09/23/09

MAXIMUM TESTING PRESSURE =	150 PSI
MAXIMUM OPERATING PRESSURE =	150 PSI
CHEMICAL SERVICE =	WATER