




PLAN VIEW

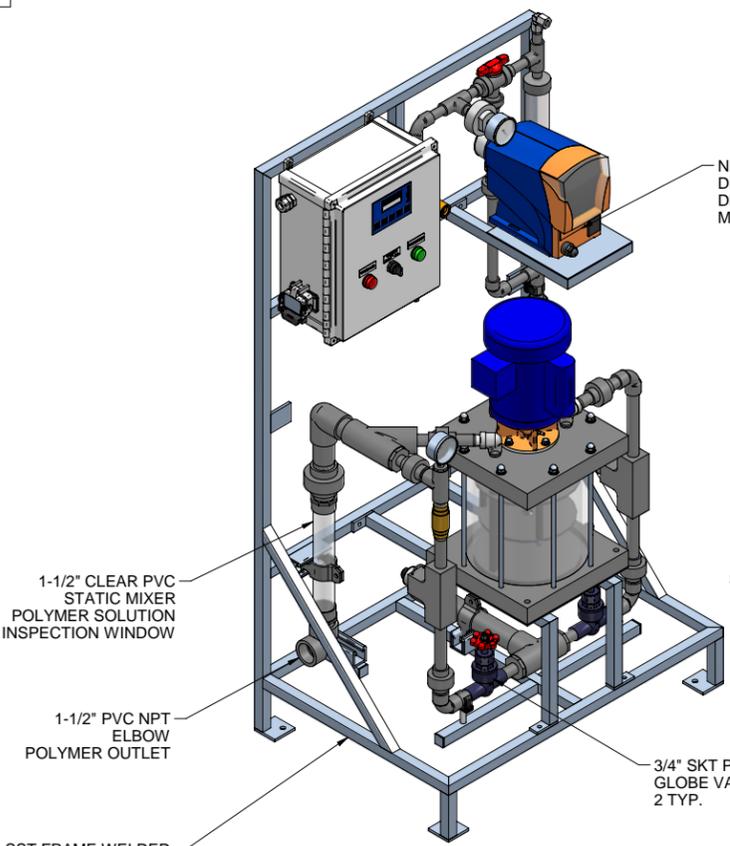


LEFT ISOMETRIC VIEW

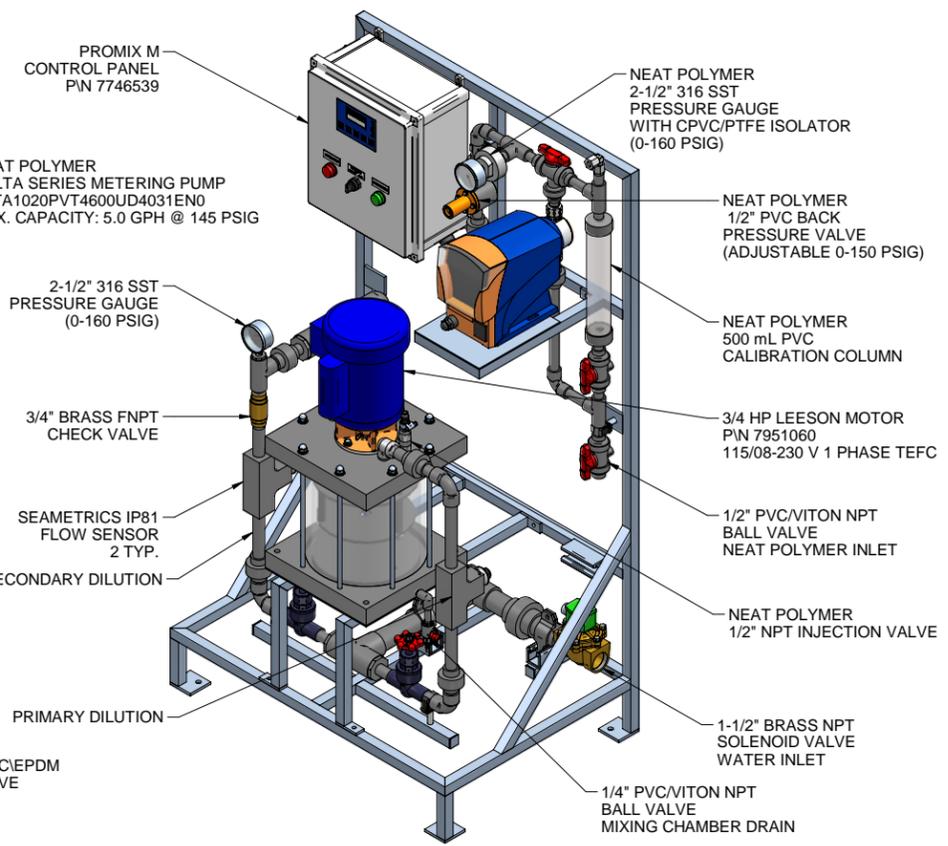


RIGHT ISOMETRIC VIEW

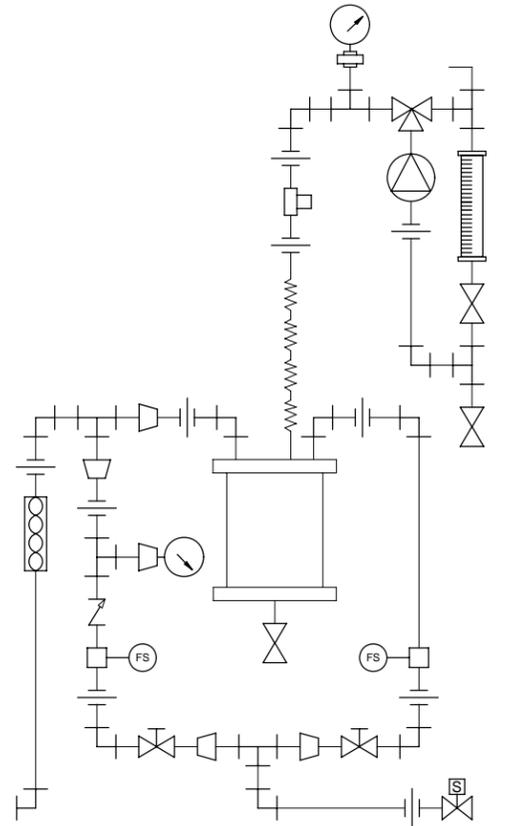

PIPING SCHEMATIC

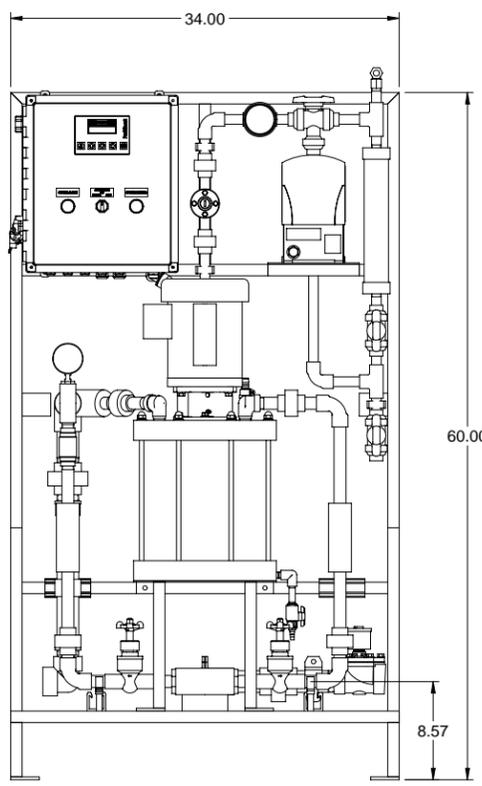

FRONT VIEW

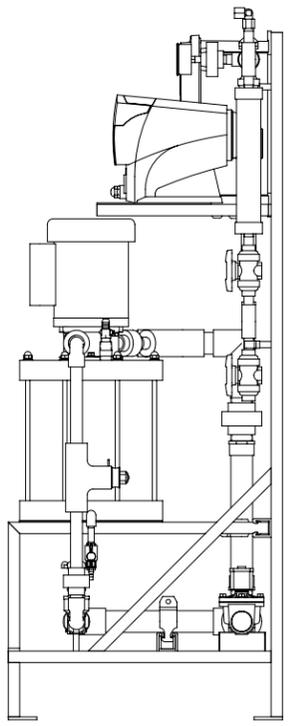

SIDE VIEW

NOTES:

- ALL PIPING AND FITTINGS SHALL BE 1/2", 3/4" AND 1-1/2" SCH. 80 PVC SOCKET WELD WITH VITON SEALS AS REQUIRED BY COMPONENTS.
- PUMP MAXIMUM CAPACITY RATES BASED ON PUMPING WATER. THE PUMP MAXIMUM CAPACITY PUMPING POLYMER IS 4.0 GPH @ 145 PSIG.
- EMULSION POLYMER BLENDING SYSTEM WITH THREE ZONE PVC MIXING CHAMBER.
- REQUIRED INCOMING POWER:
120VAC, 60HZ, 1 PHASE, 20 AMP CURRENT RATING AT 120 VAC
- ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

REV	DATE	DESCRIPTION	BY	APPD/REV'D
A	03/11/10	PUMP WAS DLT1020PVT4600UD4030E0	GJS	
0	02/03/10	FIRST ISSUE	GJS	

CUSTOMER **PROMINENT FLUID CONTROLS INC. (PROMIX M SYSTEM)**

JOB No **7746544** PURCHASE ORDER No **N/A**

TITLE **PROMIX M_0-600X2-4.0DB SYSTEM SKID GENERAL ARRANGEMENT**

THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.

ENGINEERS SEAL

PITTSBURGH, PA USA WWW.PROMINENT.US

PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692 FAX. 519 836 5226

PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484 FAX. 412 787 0704

DESIGNED	GJS	APPROVED	
DRAWN	GJS	SCALE	N.T.S.
CHECKED	JMS	DATE	02/03/10

MAXIMUM TESTING PRESSURE =	150 PSI
MAXIMUM OPERATING PRESSURE =	100 PSI
CHEMICAL SERVICE =	POLYMER