

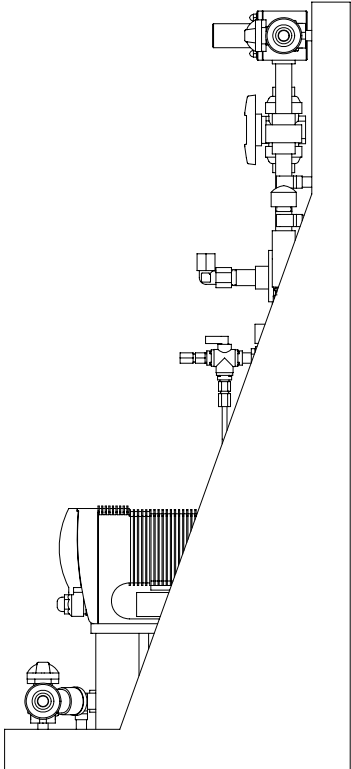


GAMMA L SERIES METERING PUMP  
GALA0220 MAX. CAPACITY: 4.3 GPH @ 29 PSIG  
GALA0413 MAX. CAPACITY: 2.8 GPH @ 58 PSIG  
GALA0420 MAX. CAPACITY: 4.12 GPH @ 58 PSIG  
GALA0708 MAX. CAPACITY: 1.74 GPH @ 101 PSIG  
GALA0713 MAX. CAPACITY: 2.77 GPH @ 101 PSIG  
GALA1005 MAX. CAPACITY: 0.95 GPH @ 145 PSIG  
GALA1008 MAX. CAPACITY: 1.66 GPH @ 145 PSIG  
GALA1605 MAX. CAPACITY: 0.87 GPH @ 232 PSIG

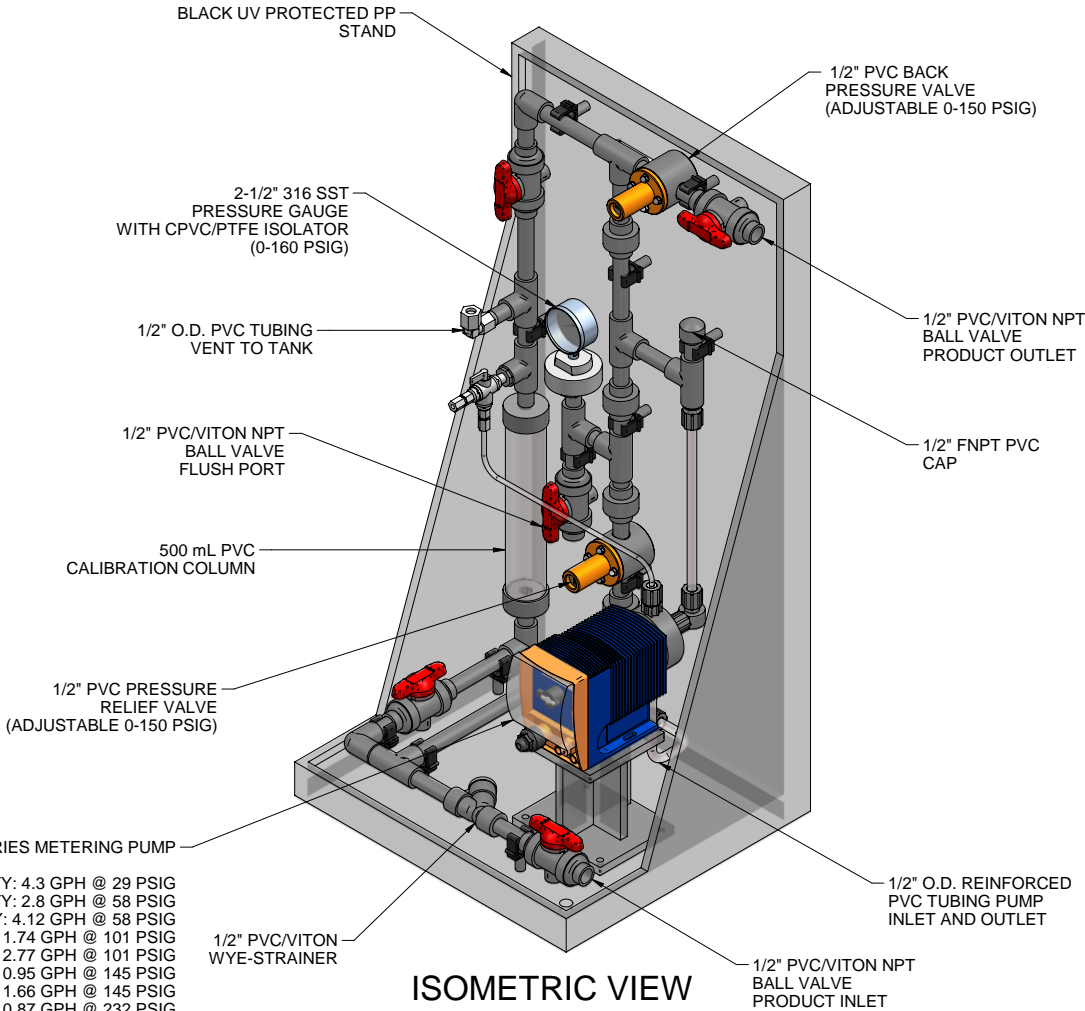


MAXIMUM TESTING PRESSURE =	150 PSI
MAXIMUM OPERATING PRESSURE =	29-150 PSI
CHEMICAL SERVICE =	

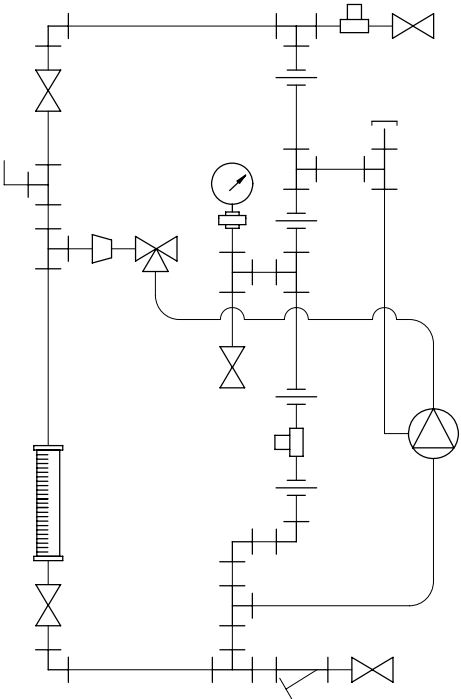

PIPING SCHEMATIC

- NOTES:
- ALL PIPING AND FITTINGS SHALL BE 1/2" SCH. 80 PVC SOCKET WELD WITH VITON SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
  - ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

A	05/06/09	REVISED PER BASIC SKID		GJS	
0	01/25/08	FIRST ISSUE		GJS	
REV	DATE	DESCRIPTION		BY	APPD REV
REVISIONS					
CUSTOMER <b>PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)</b>					
JOB No		7749017		PURCHASE ORDER No	
TITLE <b>SS1-D_FLOOR_050_PVC\ITON_DEGASS GENERAL ARRANGEMENT</b>					
THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.					
ENGINEERS SEAL		<div><div></div><div><b>ProMinent<sup>®</sup></b> <u>THE PROMINENT GROUP OF COMPANIES</u></div></div>			
		<div><div>PITTSBURGH, PA USA</div><div>WWW.PROMINENT.US</div><div><div>PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692      FAX. 519 836 5226</div><div><div>PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484      FAX. 412 787 0704</div></div></div></div>			
		DESIGNED <b>GJS</b>		APPROVED	
		DRAWN <b>GJS</b>		SCALE <b>N.T.S.</b>	
		CHECKED <b>DTH</b>		DATE <b>01/25/08</b>	
DWG No				REV	PAGE
7749017-200				A	1/1