

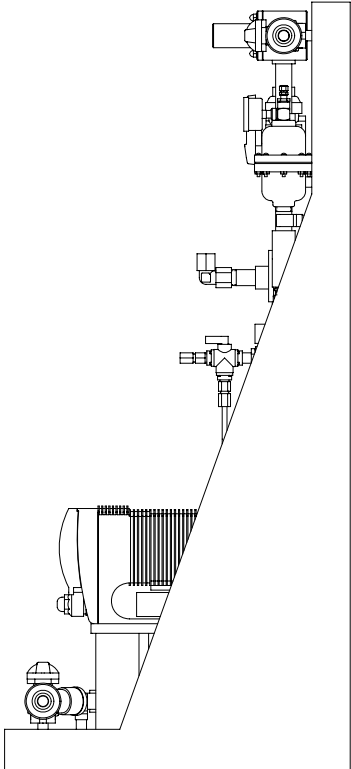


GAMMA L SERIES METERING PUMP  
GALA0220 MAX. CAPACITY: 4.3 GPH @ 29 PSIG  
GALA0413 MAX. CAPACITY: 2.8 GPH @ 58 PSIG  
GALA0420 MAX. CAPACITY: 4.12 GPH @ 58 PSIG  
GALA0708 MAX. CAPACITY: 1.74 GPH @ 101 PSIG  
GALA0713 MAX. CAPACITY: 2.77 GPH @ 101 PSIG  
GALA1005 MAX. CAPACITY: 0.95 GPH @ 145 PSIG  
GALA1008 MAX. CAPACITY: 1.66 GPH @ 145 PSIG  
GALA1605 MAX. CAPACITY: 0.87 GPH @ 232 PSIG

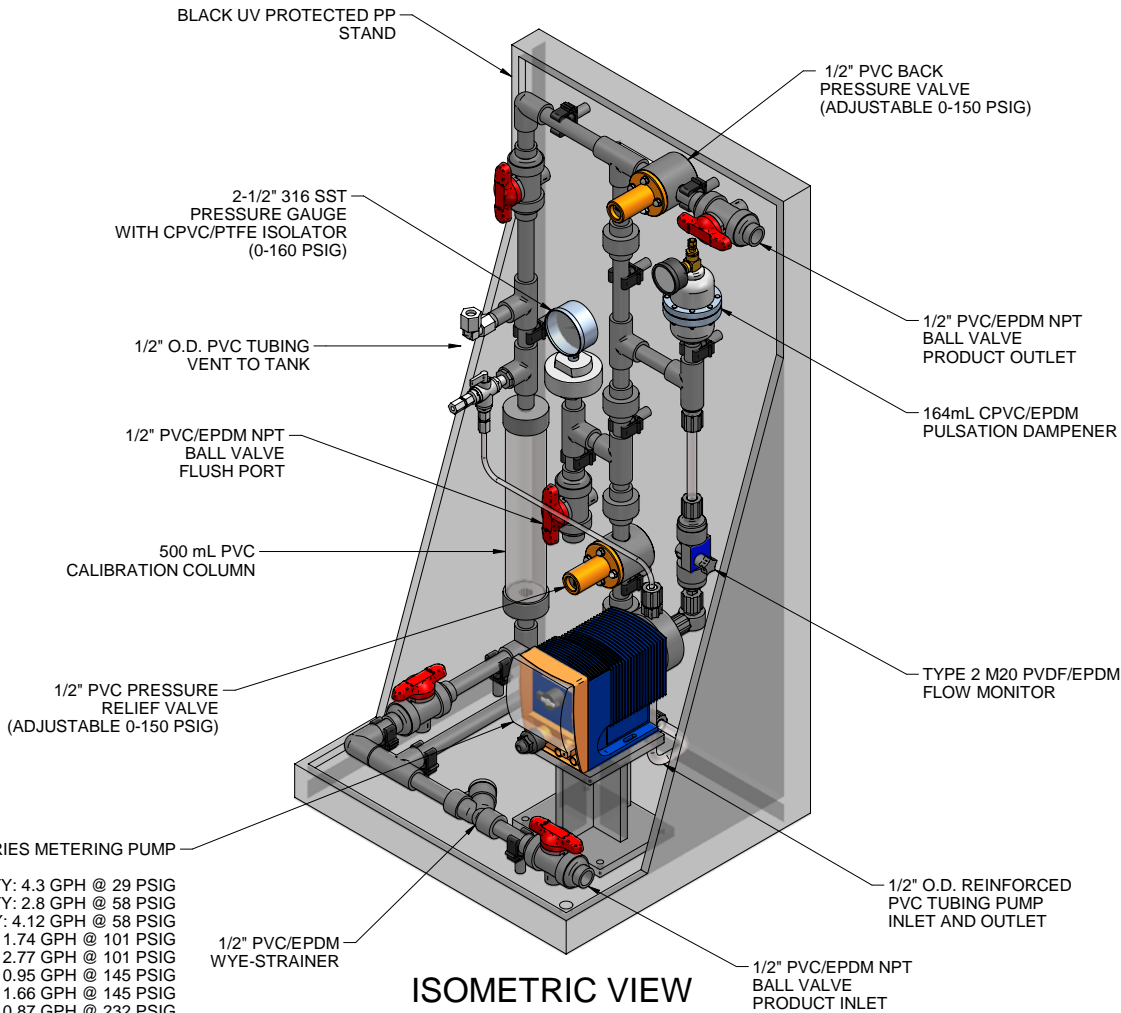


SIDE VIEW

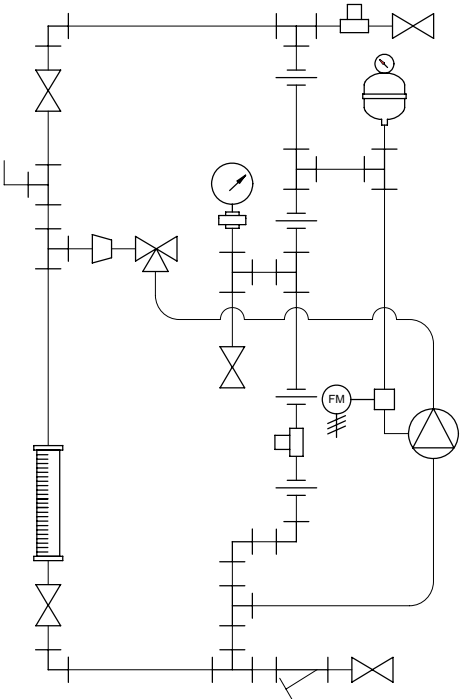

PIPING SCHEMATIC

- NOTES:
- ALL PIPING AND FITTINGS SHALL BE 1/2" SCH. 80 PVC SOCKET WELD WITH EPDM SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
  - ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

A	05/14/09	REVISED PER BASIC SKID		GJS	
0	02/01/08	FIRST ISSUE		GJS	
REV	DATE	DESCRIPTION		BY	APPD REV
REVISIONS					
CUSTOMER <b>PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)</b>					
JOB No		7749049		PURCHASE ORDER No	
TITLE <b>SS1-D_FLOOR_050_PVC\EPDM_DEGASS_PD_FM GENERAL ARRANGEMENT</b>					
THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.					
ENGINEERS SEAL		<div><div></div><div><div>ProMinent®</div><div>THE PROMINENT GROUP OF COMPANIES</div></div></div>			
		PITTSBURGH, PA USA		WWW.PROMINENT.US	
		PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692      FAX. 519 836 5226		PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484      FAX. 412 787 0704	
		DESIGNED      GJS		APPROVED	
		DRAWN      GJS		SCALE      N.T.S.	
		CHECKED      DTH		DATE      02/01/08	
DWG No				REV	PAGE
7749049-200				A	1/1

MAXIMUM TESTING PRESSURE =	150 PSI
MAXIMUM OPERATING PRESSURE =	29-150 PSI
CHEMICAL SERVICE =	