



PLAN VIEW

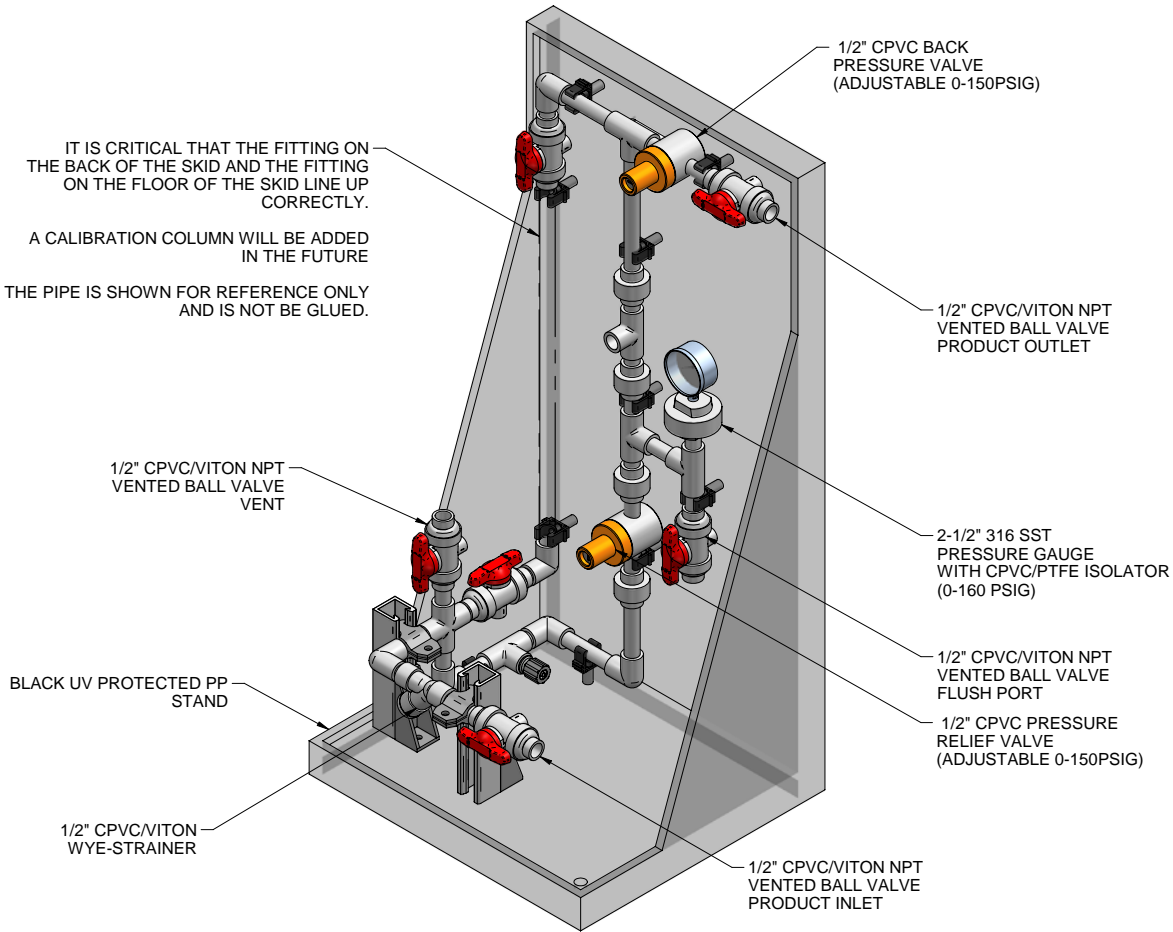


ISOMETRIC VIEW

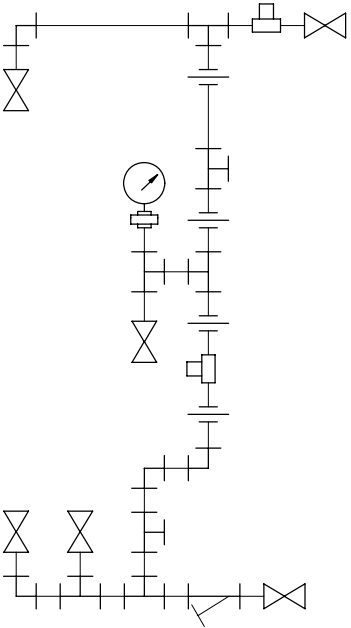


PIPING SCHEMATIC

- NOTES:
1. ALL PIPING AND FITTINGS SHALL BE 1/2" SCH. 80 CPVC SOCKET WELD WITH VITON SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
 2. ALL VALVES TO BE VENTED.
 3. ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

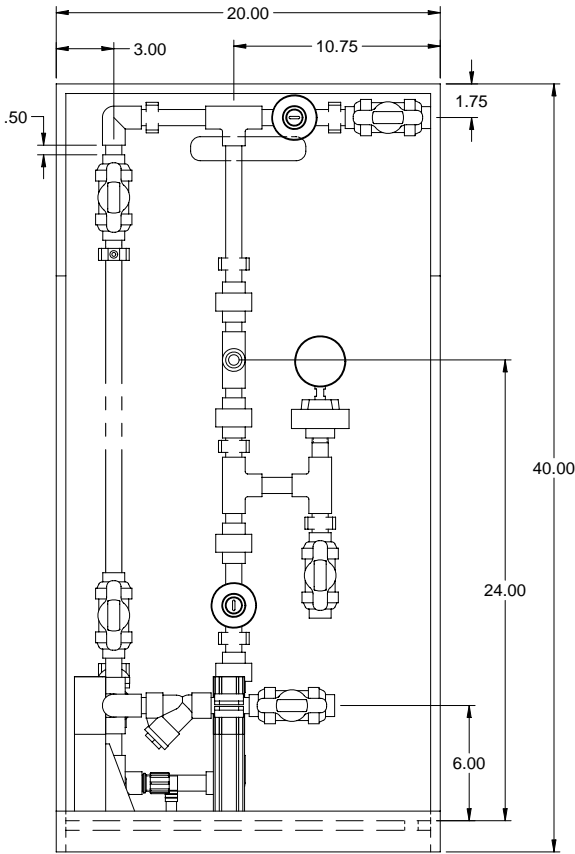


FRONT VIEW

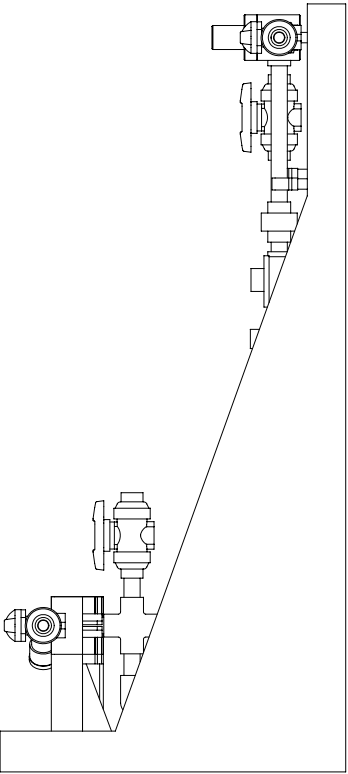

SIDE VIEW

MAXIMUM TESTING PRESSURE =	0 PSI
MAXIMUM OPERATING PRESSURE =	0 PSI
CHEMICAL SERVICE =	N/A

0	12/22/08	FIRST ISSUE		GJS	
REV	DATE	DESCRIPTION		BY	APPD/REV/D
REVISIONS					
CUSTOMER	PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)				
JOB No	7749074	PURCHASE ORDER No		N/A	
TITLE	SS1-A-B-C-D_FLOOR_050_CPVC\VITON-V BASIC SKID GENERAL ARRANGEMENT				
THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.					
ENGINEERS SEAL	<div><div></div><div><div>ProMinent®</div><div>THE PROMINENT GROUP OF COMPANIES</div></div></div>				
	PITTSBURGH, PA USA		WWW.PROMINENT.US		
	PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692 FAX. 519 836 5226		PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484 FAX. 412 787 0704		
	DESIGNED	GJS	APPROVED		
	DRAWN	GJS	SCALE N.T.S.		
	CHECKED	JMS	DATE 12/22/08		
DWG No	7749074-200			REV 0	PAGE 1/1