
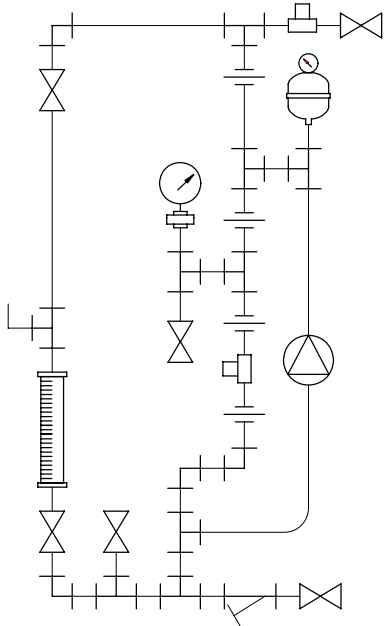



GAMMA L SERIES METERING PUMP

GALA0220 MAX. CAPACITY: 5.0 GPH @ 29 PSIG  
GALA0232 MAX. CAPACITY: 6.4 GPH @ 29 PSIG  
GALA0413 MAX. CAPACITY: 3.2 GPH @ 58 PSIG  
GALA0420 MAX. CAPACITY: 4.5 GPH @ 58 PSIG  
GALA0708 MAX. CAPACITY: 1.9 GPH @ 101 PSIG  
GALA0713 MAX. CAPACITY: 2.9 GPH @ 101 PSIG  
GALA1005 MAX. CAPACITY: 1.1 GPH @ 145 PSIG  
GALA1008 MAX. CAPACITY: 1.8 GPH @ 145 PSIG  
GALA1605 MAX. CAPACITY: 1.1 GPH @ 232 PSIG

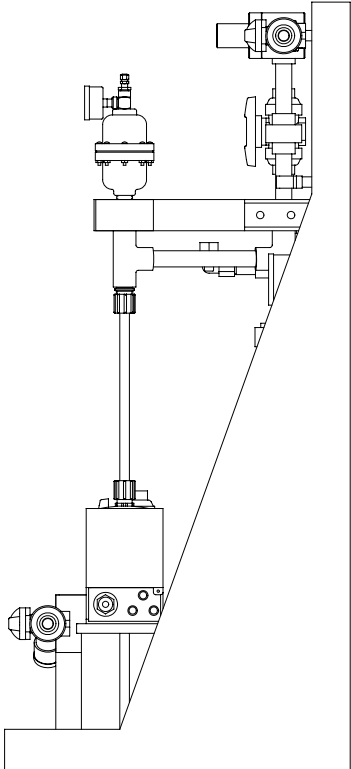

- NOTES:
- ALL PIPING AND FITTINGS SHALL BE 1/2" SCH. 80 CPVC SOCKET WELD WITH VITON SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
  - ALL VALVES TO BE VENTED.
  - ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

|   |          |  |  |                   |          |
|---|----------|--|--|-------------------|----------|
|   |          |  |  |                   |          |
| A   | 05/14/09 | REVISED PER BASIC SKID   |  | GJS               |          |
| 0   | 02/08/08 | FIRST ISSUE  |  | GJS               |          |
| REV   | DATE     | DESCRIPTION  |  | BY                | APPD REV |
| REVISIONS   |          |  |  |                   |          |
| CUSTOMER <b>PROMINENT FLUID CONTROLS INC.<br/>(PRE-ENGINEERED SYSTEM)</b>   |          |  |  |                   |          |
| JOB No  |          | 7749088  |  | PURCHASE ORDER No |          |
| TITLE <b>SS1-C_FLOOR_050_CPVC\ITON-V_PD<br/>GENERAL ARRANGEMENT</b>   |          |  |  |                   |          |
| THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC. |          |  |  |                   |          |
| ENGINEERS SEAL  |          | <div><div></div><div><b>ProMinent</b><sup>®</sup><br/>THE PROMINENT GROUP OF COMPANIES</div></div>  |  |                   |          |
|   |          | <div><div>PITTSBURGH, PA USA</div><div>WWW.PROMINENT.US</div><div><div>PROMINENT FLUID CONTROLS LTD.<br/>490 SOUTHGATE DRIVE.<br/>GUELPH, ONTARIO, CANADA<br/>N1H 6J3<br/>TEL. 519 836 5692FAX. 519 836 5226</div><div>PROMINENT FLUID CONTROLS INC.<br/>RIDC PARK WEST<br/>136 INDUSTRY DRIVE,<br/>PITTSBURGH P.A., USA. 15275<br/>TEL. 412 787 2484FAX. 412 787 0704</div></div></div> |  |                   |          |
|   |          | <div><div>DESIGNED<b>GJS</b>APPROVED</div><div>DRAWN<b>GJS</b>SCALE<b>N.T.S.</b></div><div>CHECKED<b>DTH</b>DATE<b>02/08/08</b></div></div>  |  |                   |          |
| DWG No  |          |  |  | REV               | PAGE     |
| 7749088-200   |          |  |  | A                 | 1/1      |

|                              |            |
|------------------------------|------------|
| MAXIMUM TESTING PRESSURE =   | 150 PSI    |
| MAXIMUM OPERATING PRESSURE = | 29-150 PSI |
| CHEMICAL SERVICE =           |            |