
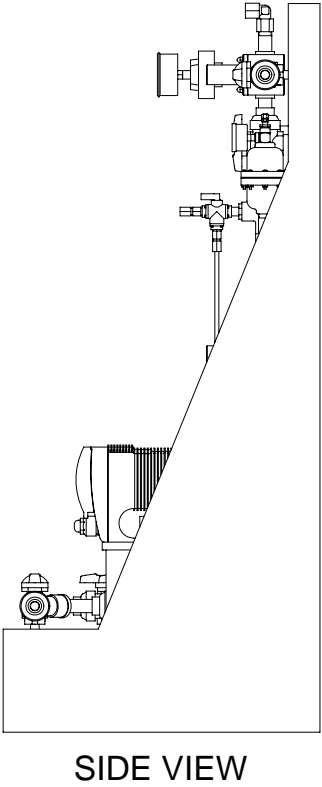



PIPING SCHEMATIC

- NOTES:
- ALL PIPING AND FITTINGS SHALL BE 1/2" SCH. 80 PVC SOCKET WELD WITH EPDM SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
  - ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

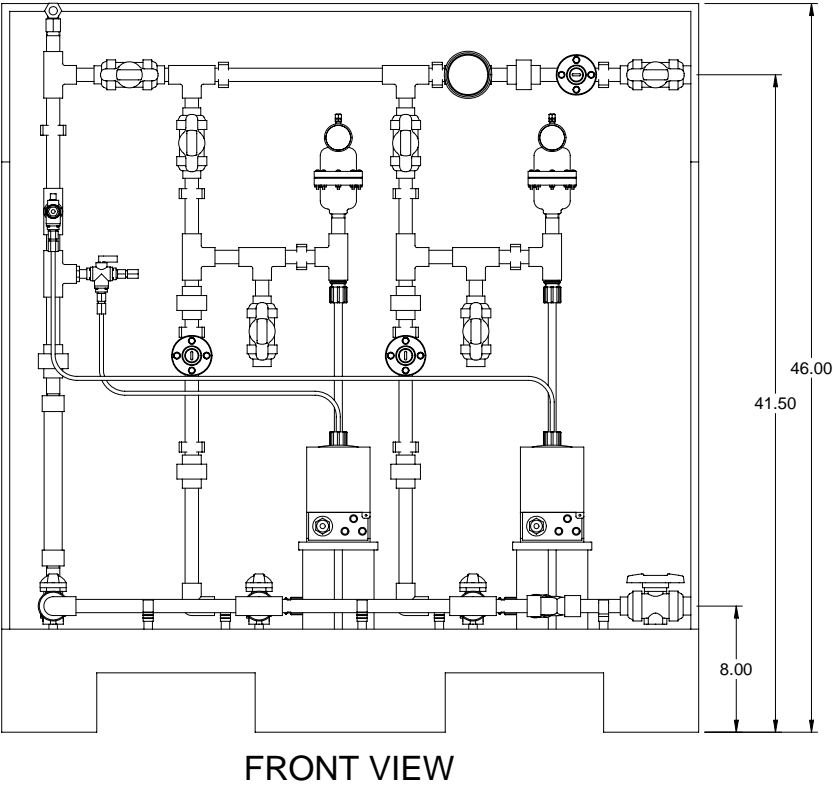

SIDE VIEW

MAXIMUM TESTING PRESSURE =	150 PSI
MAXIMUM OPERATING PRESSURE =	150 PSI
CHEMICAL SERVICE =	

A	05/14/09	REVISED PER BASIC SKID		GJS													
0	02/04/08	FIRST ISSUE		GJS													
REV	DATE	DESCRIPTION		BY	APPD/REV'D												
REVISIONS																	
CUSTOMER <b>PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)</b>																	
JOB No		7749168		PURCHASE ORDER No													
TITLE <b>SS2-B_FLOOR_050_PVC\EPDM_DEGAS_PD GENERAL ARRANGEMENT</b>																	
THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.																	
ENGINEERS SEAL		<div><div></div><div><b>ProMinent</b><sup>®</sup> THE PROMINENT GROUP OF COMPANIES</div></div>															
		<div><div>PITTSBURGH, PA USA</div><div>WWW.PROMINENT.US</div><div><div>PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692    FAX. 519 836 5226</div><div><div>PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484    FAX. 412 787 0704</div></div></div></div>															
		<table><tr><td>DESIGNED</td><td>GJS</td><td>APPROVED</td><td></td></tr><tr><td>DRAWN</td><td>GJS</td><td>SCALE</td><td>N.T.S.</td></tr><tr><td>CHECKED</td><td>DTH</td><td>DATE</td><td>02/04/08</td></tr></table>				DESIGNED	GJS	APPROVED		DRAWN	GJS	SCALE	N.T.S.	CHECKED	DTH	DATE	02/04/08
DESIGNED	GJS	APPROVED															
DRAWN	GJS	SCALE	N.T.S.														
CHECKED	DTH	DATE	02/04/08														
DWG No			REV	PAGE													
7749168-200			A	1/1													