

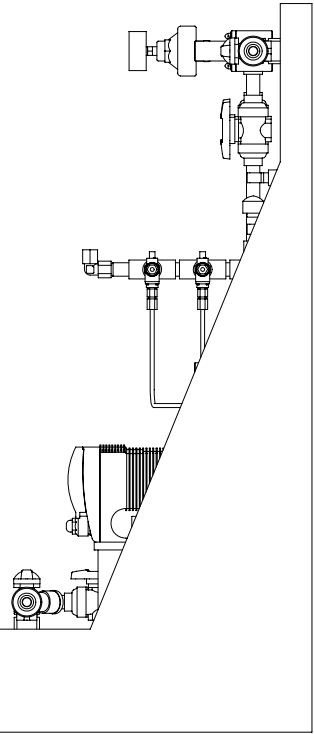



GAMMA L SERIES METERING PUMP  
2 TYP.  
GALA0220 MAX. CAPACITY: 4.3 GPH @ 29 PSIG  
GALA0413 MAX. CAPACITY: 2.8 GPH @ 58 PSIG  
GALA0420 MAX. CAPACITY: 4.12 GPH @ 58 PSIG  
GALA0708 MAX. CAPACITY: 1.74 GPH @ 101 PSIG  
GALA0713 MAX. CAPACITY: 2.77 GPH @ 101 PSIG  
GALA1005 MAX. CAPACITY: 0.95 GPH @ 145 PSIG  
GALA1008 MAX. CAPACITY: 1.66 GPH @ 145 PSIG  
GALA1605 MAX. CAPACITY: 0.87 GPH @ 232 PSIG

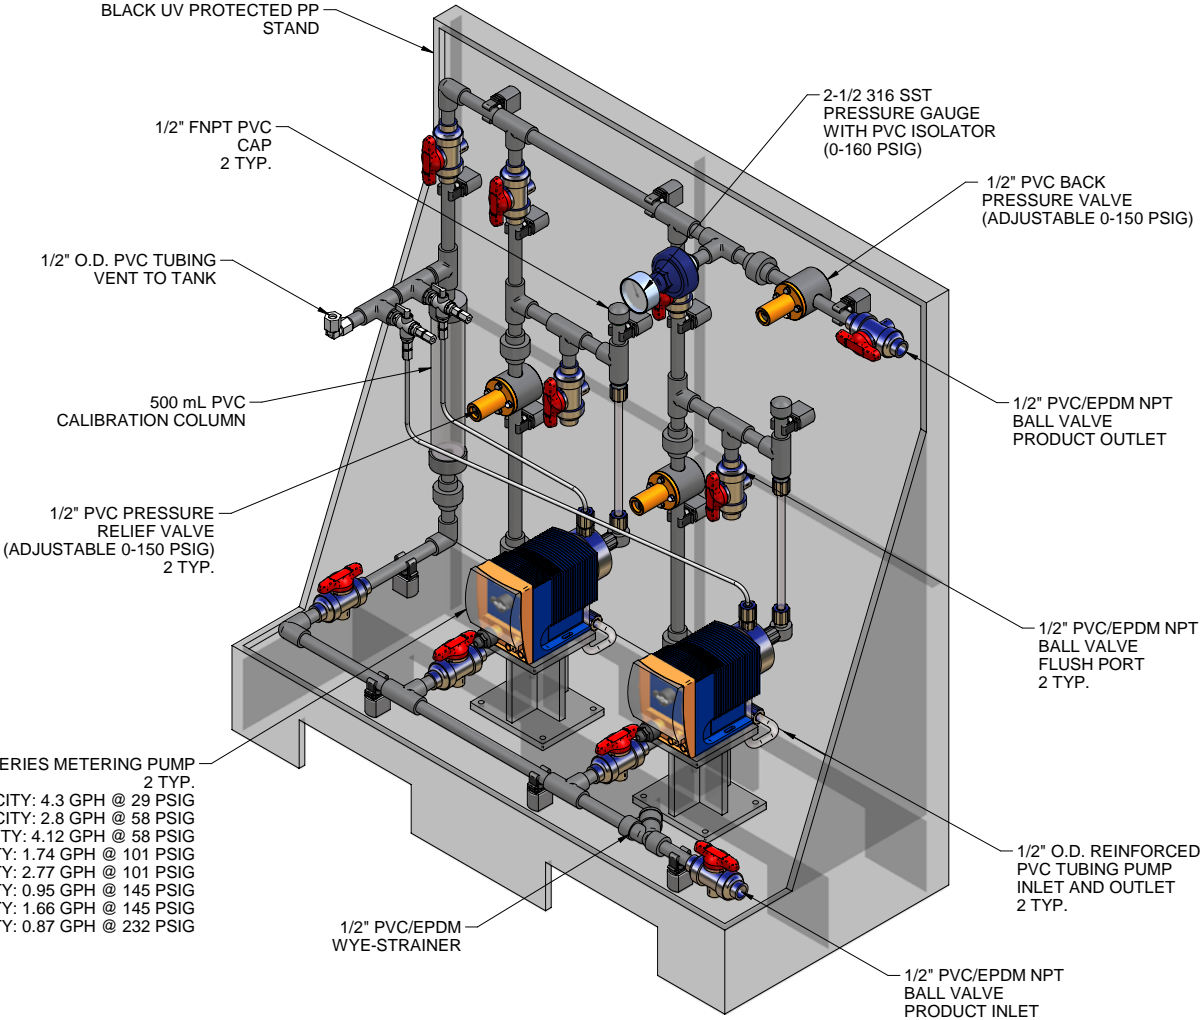

MAXIMUM TESTING PRESSURE =	150 PSI
MAXIMUM OPERATING PRESSURE =	29-232 PSI
CHEMICAL SERVICE =	

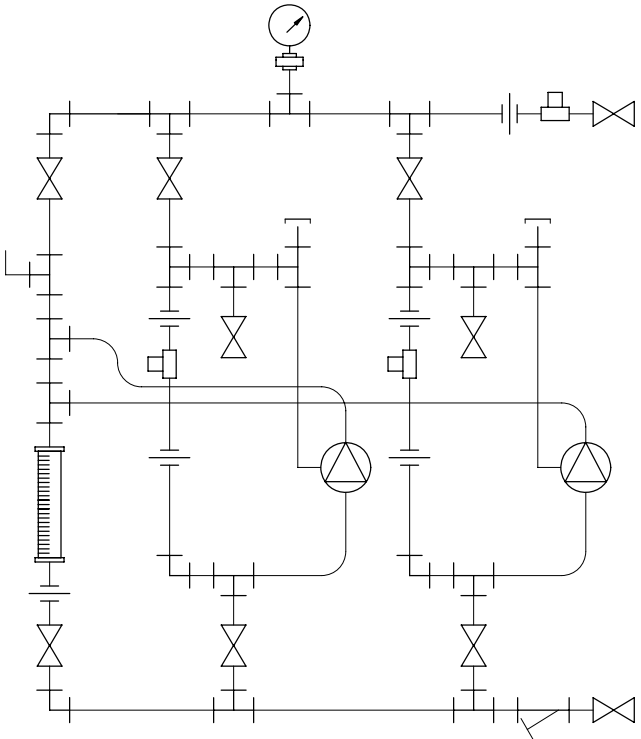

- NOTES:
- ALL PIPING AND FITTINGS SHALL BE 1/2" SCH. 80 PVC SOCKET WELD WITH VITON SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
  - ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

0	02/04/08	FIRST ISSUE		GJS	
REV	DATE	DESCRIPTION		BY	APPD/REV
REVISIONS					
CUSTOMER <b>PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)</b>					
JOB No		7749182		PURCHASE ORDER No	
TITLE <b>SS2-D_FLOOR_050_PVC\EPDM_DEGAS GENERAL ARRANGEMENT</b>					
THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.					
ENGINEERS SEAL		<div><div></div><div><b>ProMinent<sup>®</sup></b> THE PROMINENT GROUP OF COMPANIES</div></div>			
		PITTSBURGH, PA USA		WWW.PROMINENT.US	
		PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692 FAX. 519 836 5226		PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484 FAX. 412 787 0704	
		DESIGNED <b>GJS</b>		APPROVED	
		DRAWN <b>GJS</b>		SCALE <b>N.T.S.</b>	
		CHECKED <b>DTH</b>		DATE <b>02/04/08</b>	
DWG No				REV	PAGE
7749182-200				0	1/1