



PLAN VIEW

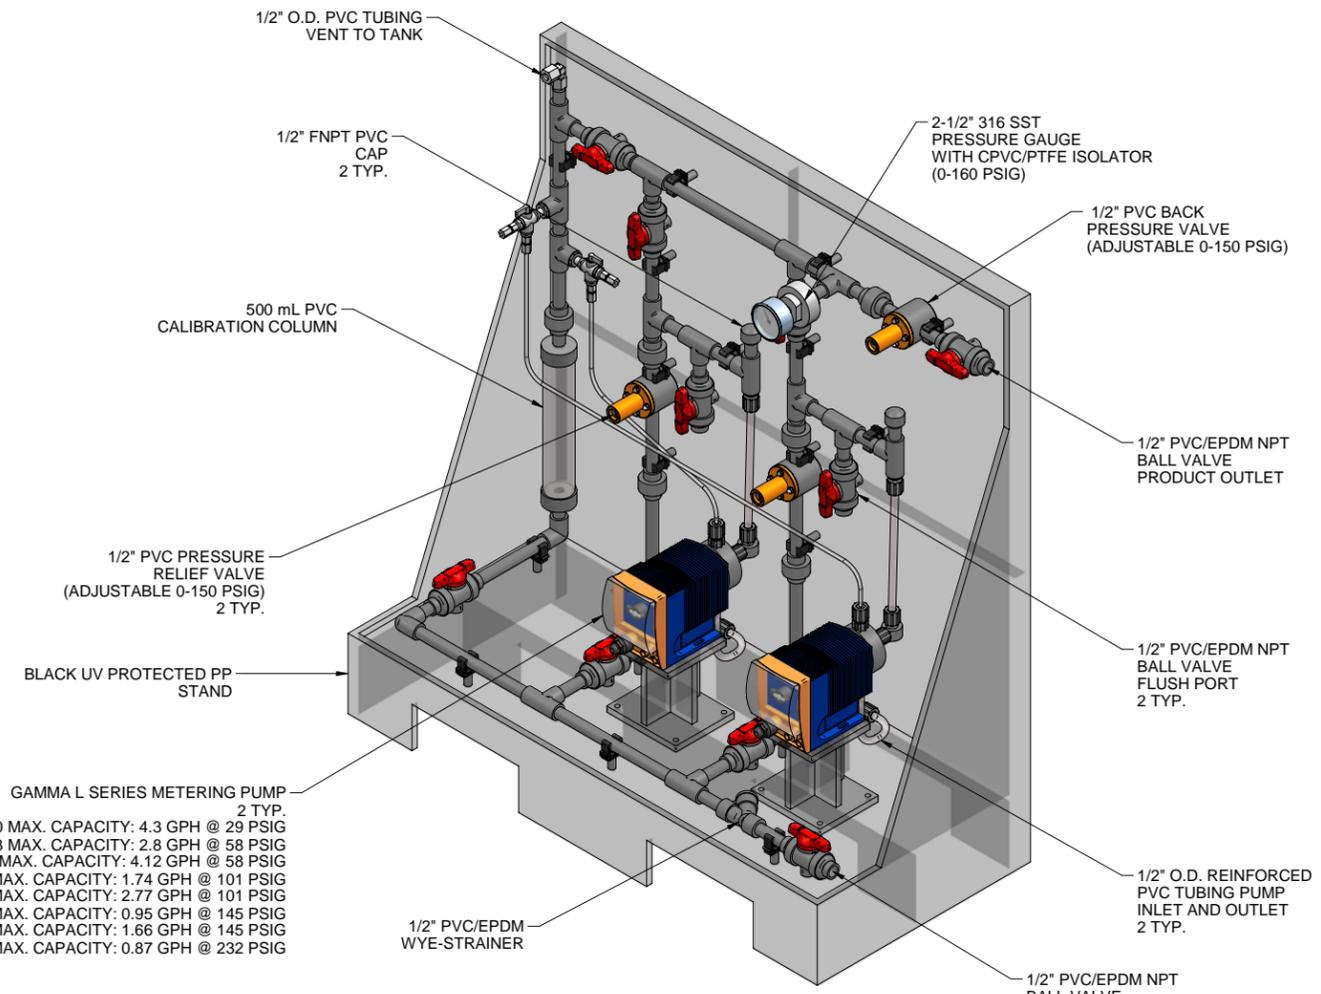


ISOMETRIC VIEW

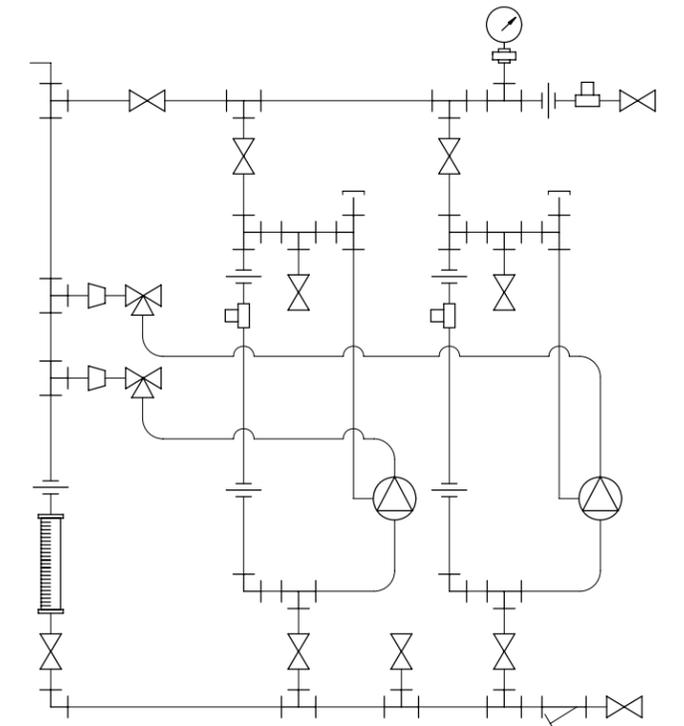


PIPING SCHEMATIC

- NOTES:
1. ALL PIPING AND FITTINGS SHALL BE 1/2" SCH. 80 PVC SOCKET WELD WITH EPDM SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
  2. ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

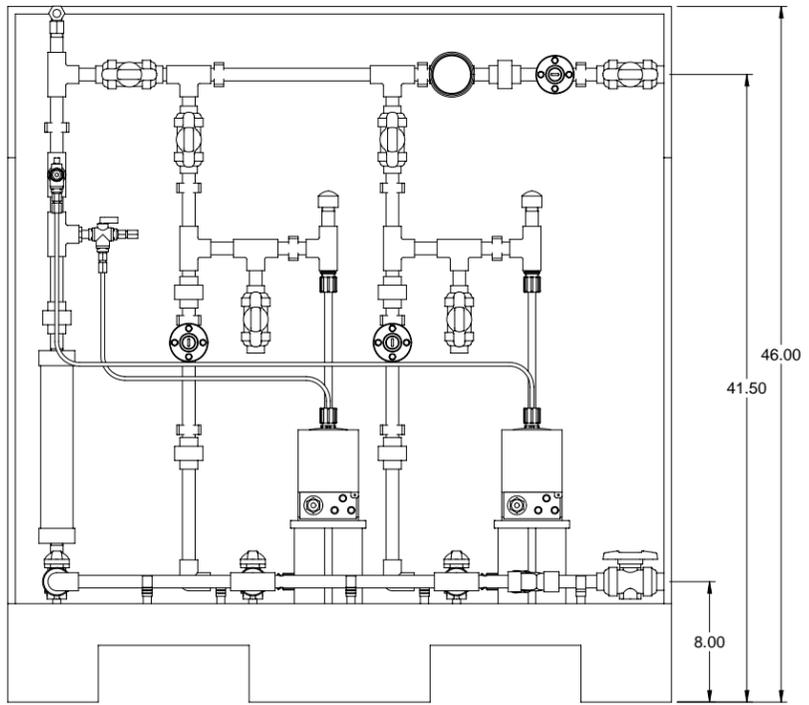

FRONT VIEW

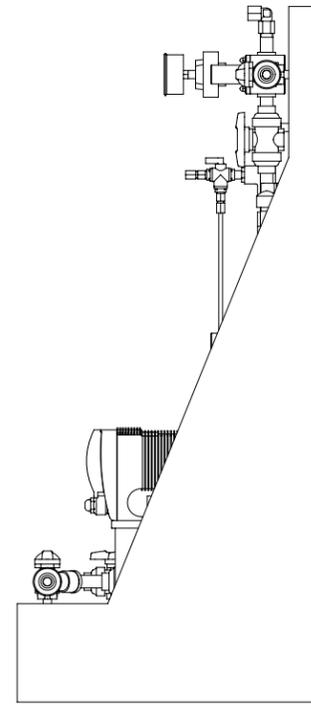

SIDE VIEW

MAXIMUM TESTING PRESSURE =	150 PSI
MAXIMUM OPERATING PRESSURE =	29-150 PSI
CHEMICAL SERVICE =	

REV	DATE	DESCRIPTION	BY	APPD	REVD
A	05/14/09	REVISED PER BASIC SKID	GJS		
0	02/04/08	FIRST ISSUE	GJS		

REVISIONS

CUSTOMER **PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)**

JOB No **7749182** PURCHASE ORDER No

TITLE **SS2-D\_FLOOR\_050\_PVC/EPDM\_DEGAS GENERAL ARRANGEMENT**

THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.

ENGINEERS SEAL	<p><b>ProMinent</b><sup>®</sup> THE PROMINENT GROUP OF COMPANIES</p>
PITTSBURGH, PA USA WWW.PROMINENT.US	
PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692 FAX. 519 836 5226	PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484 FAX. 412 787 0704
DESIGNED <b>GJS</b>	APPROVED
DRAWN <b>GJS</b>	SCALE <b>N.T.S.</b>
CHECKED <b>DTH</b>	DATE <b>02/04/08</b>

DWG No **7749182-200** REV **A** PAGE **1/1**