




GAMMA L SERIES METERING PUMP  
2 TYP.  
GALA1000 MAX. CAPACITY: 0.19 GPH @ 145 PSIG  
GALA1601 MAX. CAPACITY: 0.29 GPH @ 232 PSIG  
GALA1602 MAX. CAPACITY: 0.55 GPH @ 232 PSIG

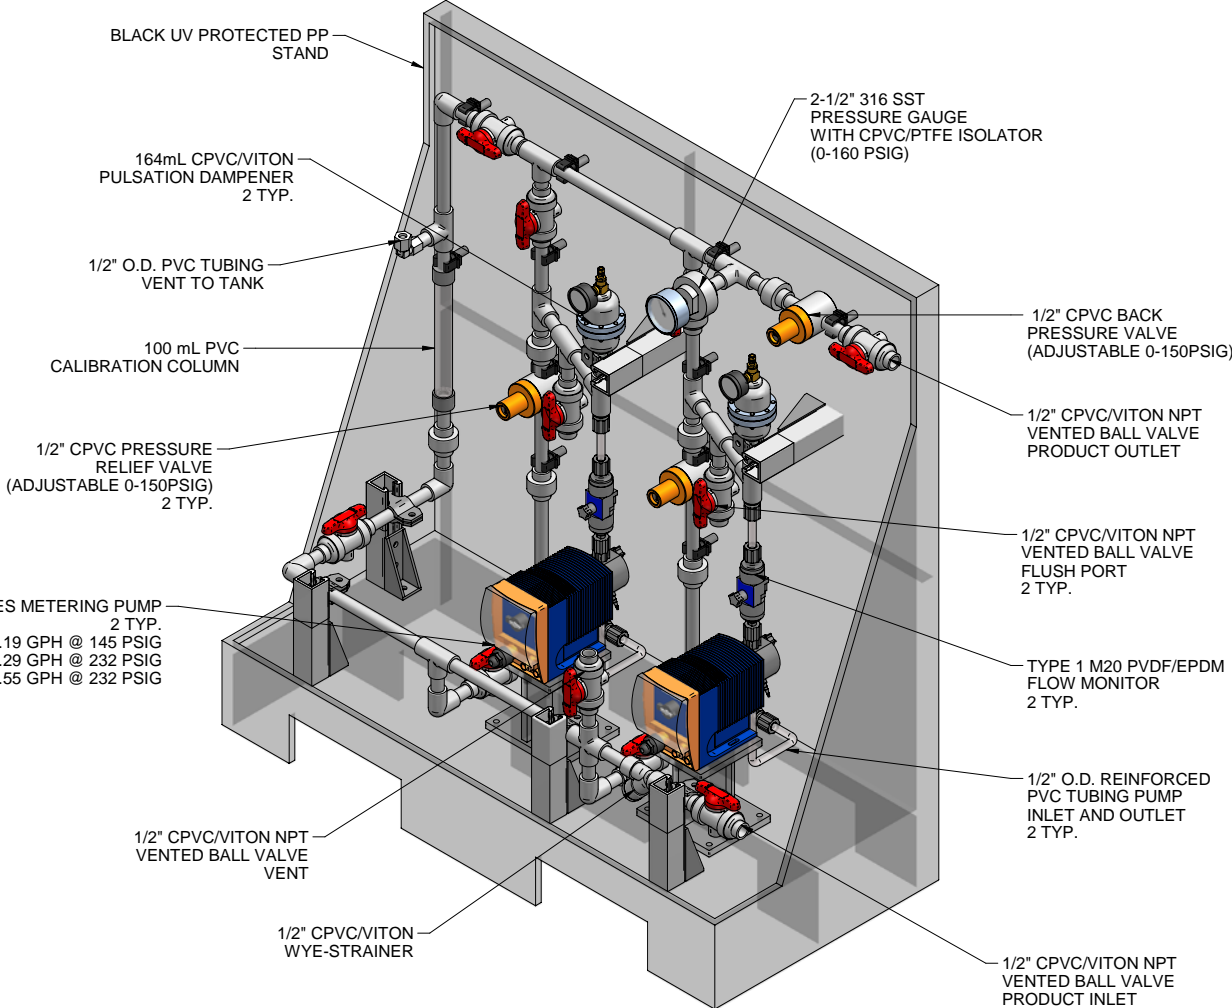


ISOMETRIC VIEW

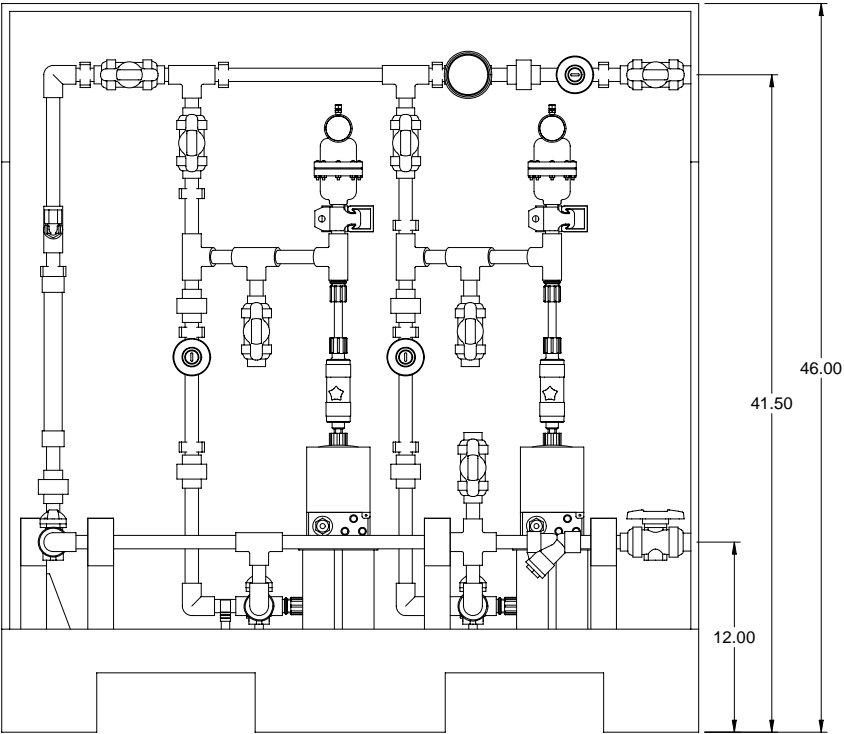

FRONT VIEW

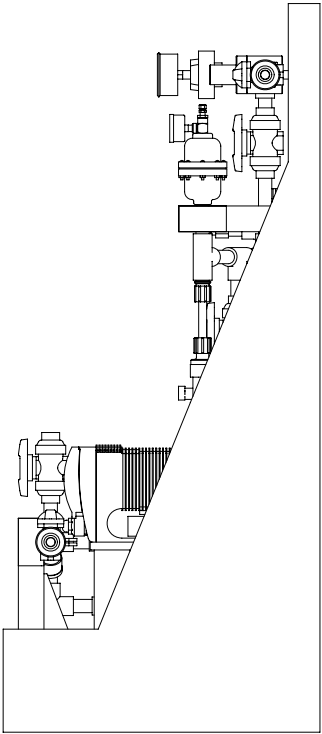


SIDE VIEW

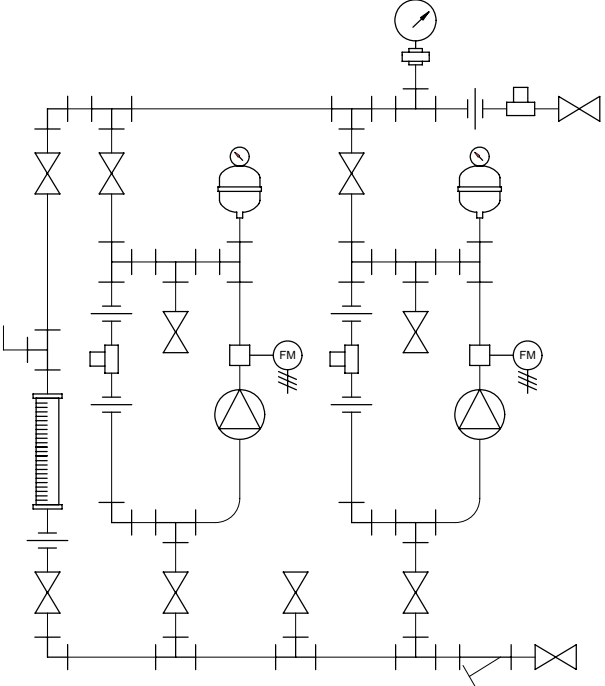

PIPING SCHEMATIC

- NOTES:
- 1. ALL PIPING AND FITTINGS SHALL BE 1/2" SCH. 80 CPVC SOCKET WELD WITH VITON SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
  - 2. ALL VALVES TO BE VENTED.
  - 3. ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

A	05/14/09	REVISED PER BASIC SKID		GJS	
0	02/11/08	FIRST ISSUE		GJS	
REV	DATE	DESCRIPTION		BY	APPD REV
REVISIONS					
CUSTOMER <b>PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)</b>					
JOB No		7749207		PURCHASE ORDER No	
TITLE <b>SS2-A_FLOOR_050_CPVC\ITON-V_PD_FM GENERAL ARRANGEMENT</b>					
THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.					
ENGINEERS SEAL		<div><div></div><div><b>ProMinent</b><sup>®</sup> THE PROMINENT GROUP OF COMPANIES</div></div>			
		<div><div>PITTSBURGH, PA USA</div><div>WWW.PROMINENT.US</div><div><div>PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692    FAX. 519 836 5226</div><div><div>PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484    FAX. 412 787 0704</div></div></div></div>			
DESIGNED		GJS		APPROVED	
DRAWN		GJS		SCALE N.T.S.	
CHECKED		DTH		DATE 02/11/08	
DWG No				REV	PAGE
7749207-200				A	1/1

MAXIMUM TESTING PRESSURE = 150 PSI  
MAXIMUM OPERATING PRESSURE = 145-150 PSI  
CHEMICAL SERVICE =