

NOTES:

- 1. ALL PIPING AND FITTINGS SHALL BE 1/2" SCH. 80 CPVC SOCKET WELD WITH EPDM SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
- 2. ALL VALVES TO BE VENTED.
- 3. ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE

ONLY.										
0	02/11/08	FIR	ST ISSUE	GJS						
REV	DATE	DES	CRIPTION	BY	APPD	REVD				
REVISIONS										
CUSTOMER PROMINENT FLUID CONTROLS INC.										
(PRE-ENGINEERED SYSTEM)										

PURCHASE ORDER No

JOB No 7749223

> SS2-C_FLOOR_050_CPVC\VITON-V **GENERAL ARRANGEMENT**

THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.

PITTSBURGH PAUSA

ENGINEERS SEAL

TITLE






WWW PROMINENT US

	FILLODOKOLI, FA OSA		WWW.FIXOWIINLINT.03				
	PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3			PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275			
	TEL. 519 836 5692	FAX. 519 836 5226	TEL. 412 787 2484 FAX. 412 787 0704				
	DESIGNED GJS		APPROVED				
	DRAWN	GJS	SCALE N.T.S.		I.T.S.		
	CHECKED	DTH	DATE 02/11/08				
				REV	PAGE		
1	9223-200	1		0	1/1		
43223-200				U	1/1		

SIDE VIEW

MAXIMUM OPERATING PRESSURE = 29-232 PSI

MAXIMUM TESTING PRESSURE = 150 PSI DWG No 7749223-200 CHEMICAL SERVICE =

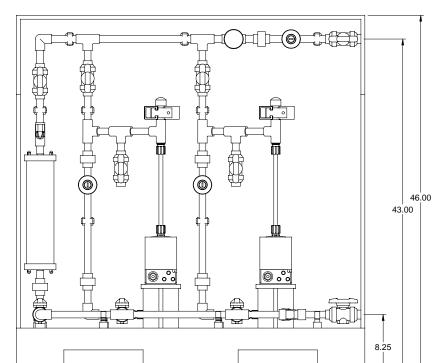

FRONT VIEW