



PLAN VIEW

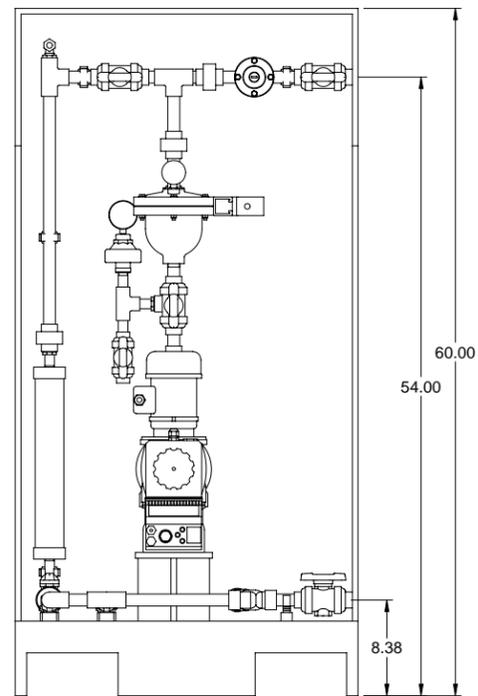


FRONT VIEW


- S1BAH04084 MAX. CAPACITY: 26.7 GPH @ 58 PSIG
- S1CAH04084 MAX. CAPACITY: 26.7 GPH @ 58 PSIG
- S1BAH04120 MAX. CAPACITY: 38.0 GPH @ 58 PSIG
- S1CAH04120 MAX. CAPACITY: 31.7 GPH @ 58 PSIG
- S2BAHM12090 MAX. CAPACITY: 28.5 GPH @ 145 PSIG
- S2CAHM12090 MAX. CAPACITY: 28.5 GPH @ 145 PSIG

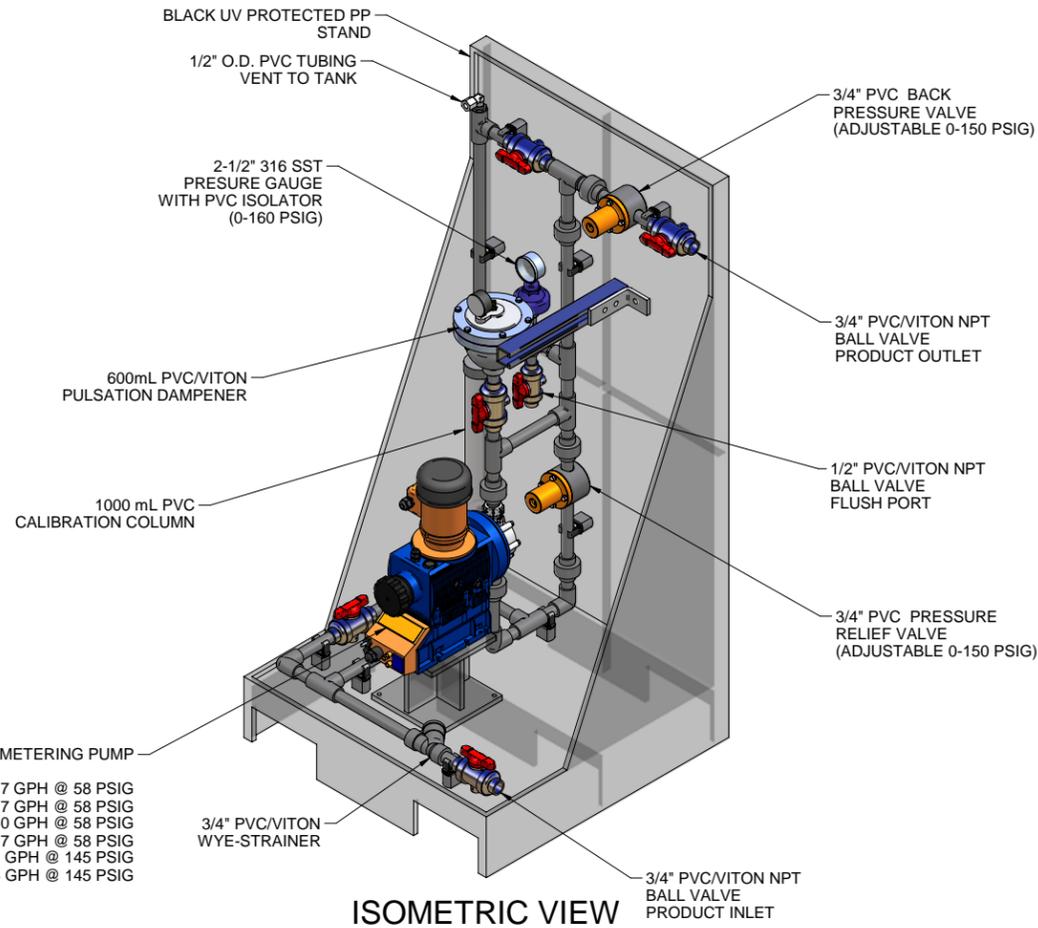

ISOMETRIC VIEW

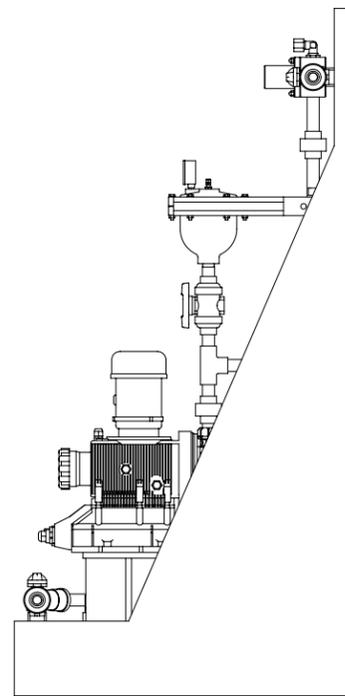

SIDE VIEW

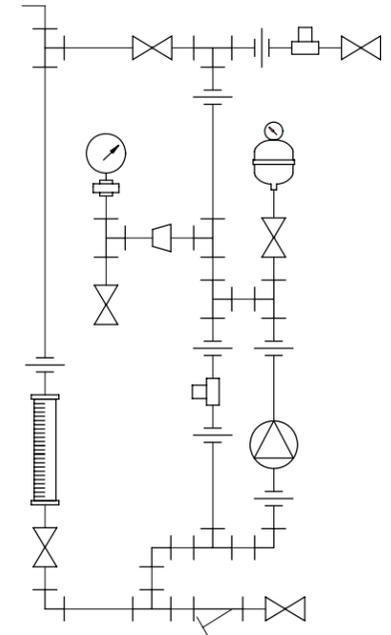

PIPING SCHEMATIC

NOTES:

1. ALL PIPING AND FITTINGS SHALL BE 3/4" SCH. 80 PVC SOCKET WELD WITH VITON SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
2. ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

REV	DATE	DESCRIPTION	BY	APPD	REVD
0	01/28/08	FIRST ISSUE	GJS		

REVISIONS					
CUSTOMER PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)					
JOB No 7749265		PURCHASE ORDER No			
TITLE MS1B-B075_FLOOR_PVCVITON_PD GENERAL ARRANGEMENT					

THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.

ENGINEERS SEAL		 <p>THE PROMINENT GROUP OF COMPANIES</p>
PITTSBURGH, PA USA		WWW.PROMINENT.US
PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692 FAX. 519 836 5226		PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484 FAX. 412 787 0704
DESIGNED GJS	APPROVED	
DRAWN GJS	SCALE N.T.S.	
CHECKED DTH	DATE 01/28/08	

MAXIMUM TESTING PRESSURE =	150 PSI
MAXIMUM OPERATING PRESSURE =	58-145 PSI
CHEMICAL SERVICE =	