




PLAN VIEW

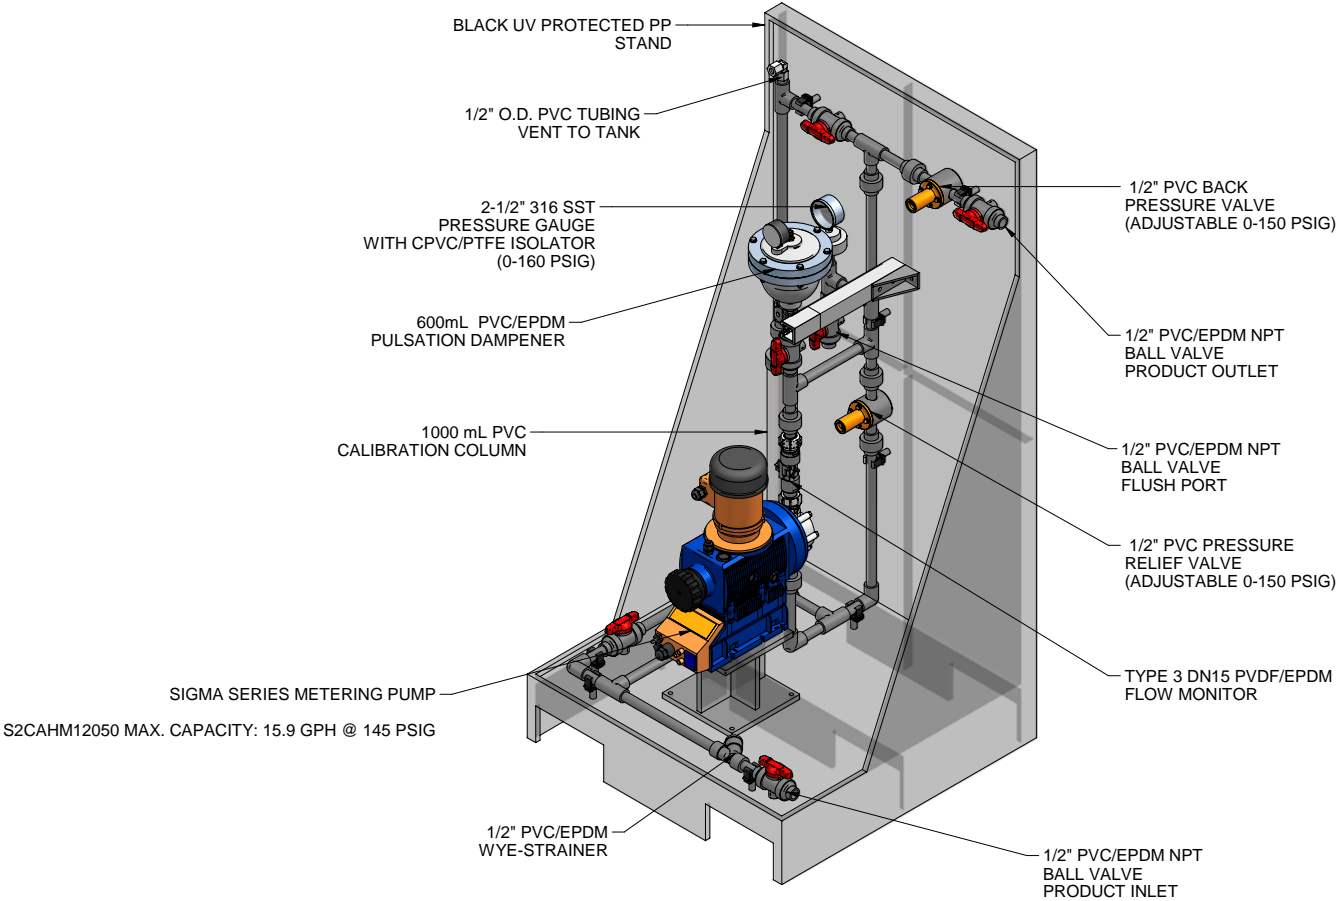


ISOMETRIC VIEW

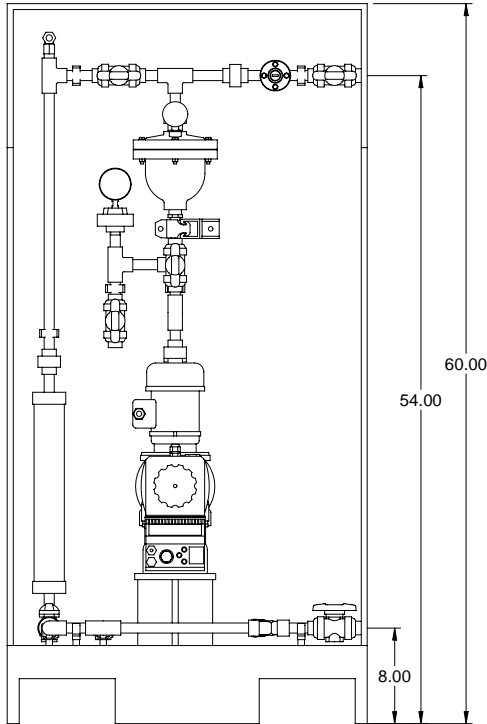

FRONT VIEW

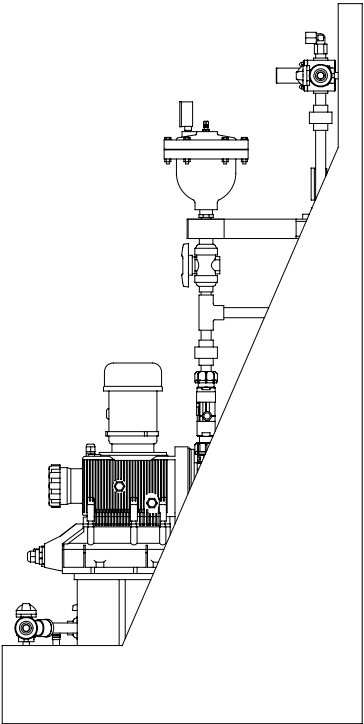


SIDE VIEW

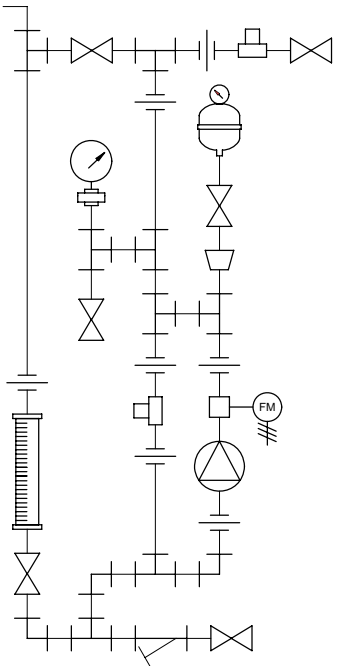

PIPING SCHEMATIC

- NOTES:
- 1. ALL PIPING AND FITTINGS SHALL BE 1/2" SCH. 80 PVC SOCKET WELD WITH EPDM SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
 - 2. ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

A	05/15/09	REVISED PER BASIC SKID		ALS													
0	03/24/08	FIRST ISSUE		GJS													
REV	DATE	DESCRIPTION		BY	APPD/REV'D												
REVISIONS																	
CUSTOMER PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)																	
JOB No		7749311		PURCHASE ORDER No													
TITLE		MS1A-C050_FLOOR_PVC\EPDM_PD_FM GENERAL ARRANGEMENT															
THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.																	
ENGINEERS SEAL		<div><div></div><div><div>ProMinent®</div><div>THE PROMINENT GROUP OF COMPANIES</div></div></div> <div><div>PITTSBURGH, PA USA</div><div>WWW.PROMINENT.US</div><div><div>PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692 FAX. 519 836 5226</div><div><div>PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484 FAX. 412 787 0704</div></div></div><div><table><tr><td>DESIGNED</td><td>GJS</td><td>APPROVED</td><td></td></tr><tr><td>DRAWN</td><td>GJS</td><td>SCALE</td><td>N.T.S.</td></tr><tr><td>CHECKED</td><td>DTH</td><td>DATE</td><td>03/24/08</td></tr></table></div></div>				DESIGNED	GJS	APPROVED		DRAWN	GJS	SCALE	N.T.S.	CHECKED	DTH	DATE	03/24/08
DESIGNED	GJS					APPROVED											
DRAWN	GJS					SCALE	N.T.S.										
CHECKED	DTH					DATE	03/24/08										
DWG No		REV		PAGE													
7749311-200		A		1/1													

MAXIMUM TESTING PRESSURE =	150 PSI
MAXIMUM OPERATING PRESSURE =	145 PSI
CHEMICAL SERVICE =	