



DWG No

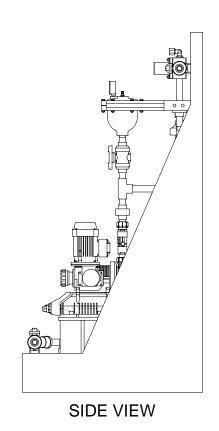

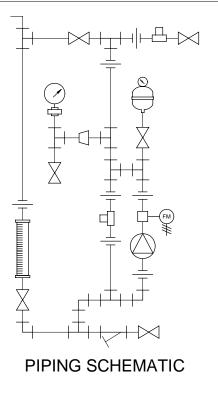

NOTES:

- 1. ALL PIPING AND FITTINGS SHALL BE 3/4" SCH. 80 PVC SOCKET WELD WITH EPDM SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
- 2. ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

0	03/24/08 FIRST ISSUE									
REV	/ DATE DESCRIPTION				APPE					
REVISIONS										
CUSTOMER PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)										
JOB No		7749315	PURCHASE ORDER No							
MS1B-A075_FLOOR_PVC\EPDM_PD_FM GENERAL ARRANGEMENT										
THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.										
E	NGINEERS SEAL	pfc	ProMir	ne	n					



GJS BY APPD REVD

PITTS	BURGH, PA USA	V	VWW.PROMIN	IENT.US	
PROMINENT FLUID CONTROLS LTD.		PRO	PROMINENT FLUID CONTROLS INC.		
490 SOUTHGATE DRIVE.			RIDC PARK WEST		
GUELPH, ONTARIO, CANADA			136 INDUSTRY DRIVE,		
N1H 6J3		PITTSBURGH P.A., USA. 15275			
TEL. 519 836 5692	FAX. 519 836 5226	TEL. 4	12 787 2484	FAX. 412 787 0704	
DESIGNED	GJS	APP	ROVED		
DRAWN	GJS	SCA	LE	N.T.S.	
CHECKED	DTH	DAT	E 0;	3/24/08	
			REV	PAGE	
9315-200			0	1/1	
			()	1 1/1	

MAXIMUM TESTING PRESSURE = 150 PSI DWG No MAXIMUM OPERATING PRESSURE = 102 PSI CHEMICAL SERVICE =

774