



FRONT VIEW

PLAN VIEW

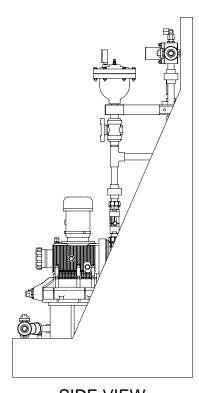

SIDE VIEW

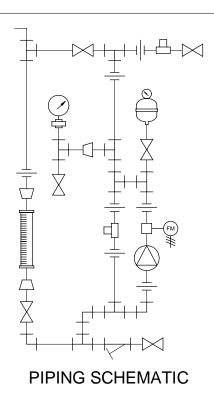

NOTES:

- 1. ALL PIPING AND FITTINGS SHALL BE 3/4" SCH. 80 PVC SOCKET WELD WITH EPDM SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
- 2. ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

Α	05/15/09	REVISED PER BASIC SKID	ALS				
0	03/24/08	FIRST ISSUE	GJS				
REV	DATE	DESCRIPTION	BY	APPD	REVD		
REVISIONS							

CUSTOMER PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)

JOB No 7749317 PURCHASE ORDER No

> MS1B-B075_FLOOR_PVC\EPDM_PD_FM GENERAL ARRANGEMENT

THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR

ENGINEERS SEAL

TITLE





PITTS	BURGH, PA USA	V	VWW.PROMINE	ENT.US		
PROMINENT FLUID CONTROLS LTD.		PROMINENT FLUID CONTROLS INC.				
490 SOUTHGATE DRIVE.			RIDC PARK WEST			
GUELPH, ONTARIO, CANADA			136 INDUSTRY DRIVE,			
N1H 6J3		PITTSBURGH P.A., USA. 15275				
TEL. 519 836 5692	FAX. 519 836 5226	TEL. 4	12 787 2484 F	FAX. 412 787 0704		
DESIGNED	GJS	APP	ROVED			
DESIGNED DRAWN	GJS GJS	APP SCA		I.T.S.		
		+	LE N	N.T.S. /24/08		
DRAWN	GJS	SCA	LE N			

MAXIMUM TESTING PRESSURE = 150 PSI DWG No MAXIMUM OPERATING PRESSURE = 58-145 PSI CHEMICAL SERVICE =

7749317-200

А