

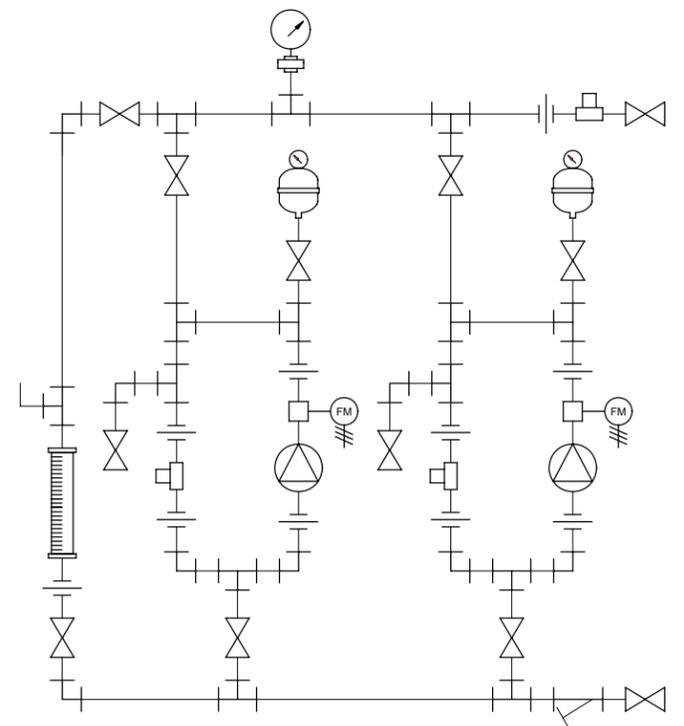
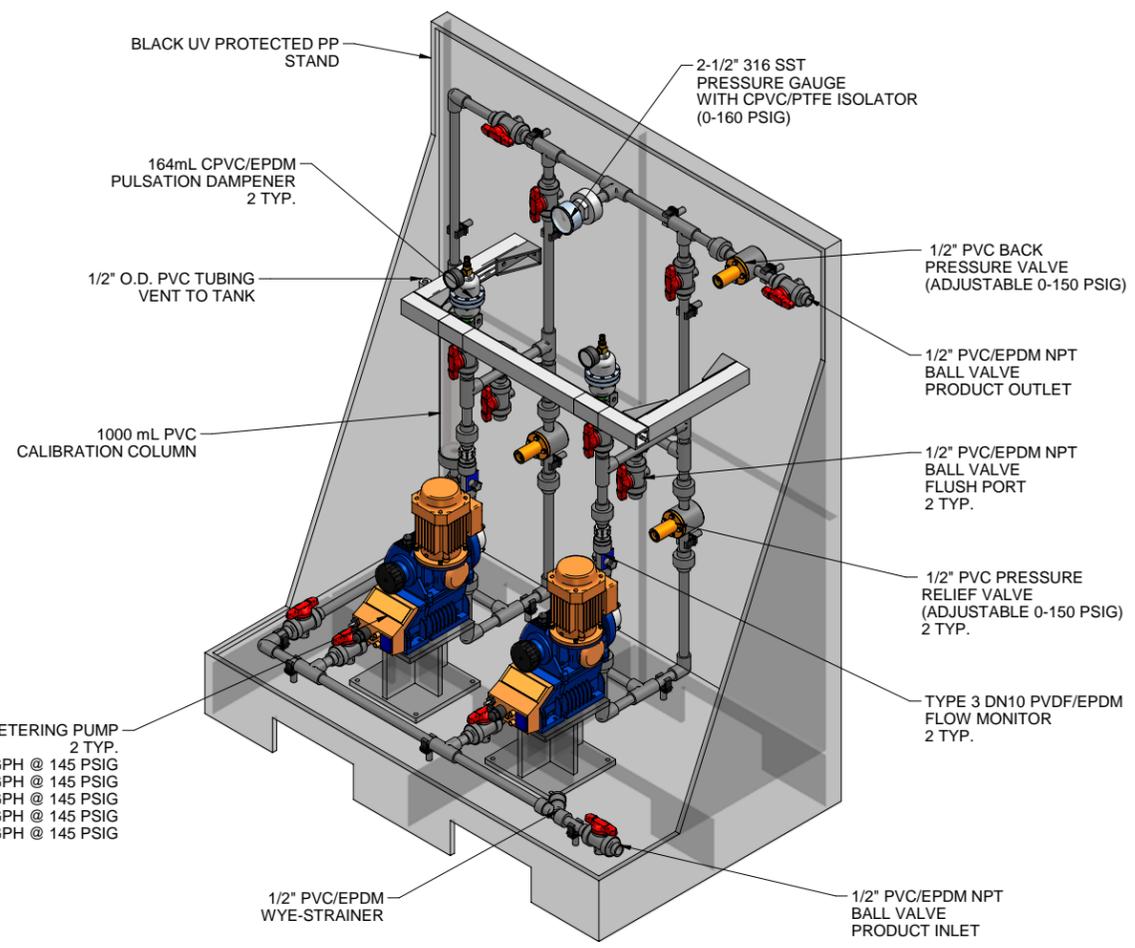


SIGMA SERIES METERING PUMP
2 TYP.

S1CAH10022 MAX. CAPACITY: 6.8 GPH @ 145 PSIG
 S1CAH10044 MAX. CAPACITY: 14.0 GPH @ 145 PSIG
 S1CAH10050 MAX. CAPACITY: 13.2 GPH @ 145 PSIG
 S1CAH12017 MAX. CAPACITY: 5.3 GPH @ 145 PSIG
 S1CAH12035 MAX. CAPACITY: 11.1 GPH @ 145 PSIG

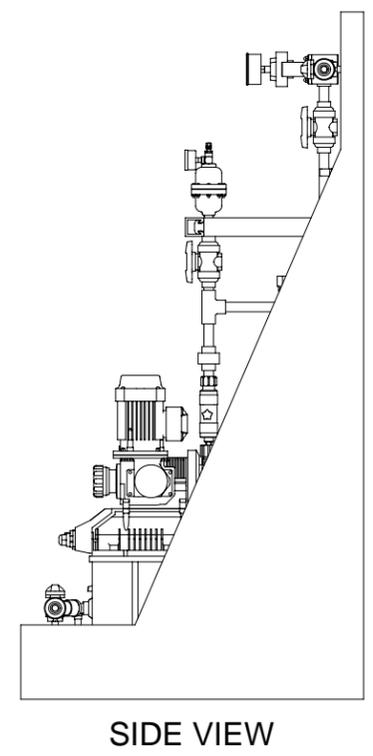

- NOTES:**
- ALL PIPING AND FITTINGS SHALL BE 1/2" SCH. 80 PVC SOCKET WELD WITH EPDM SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
 - ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

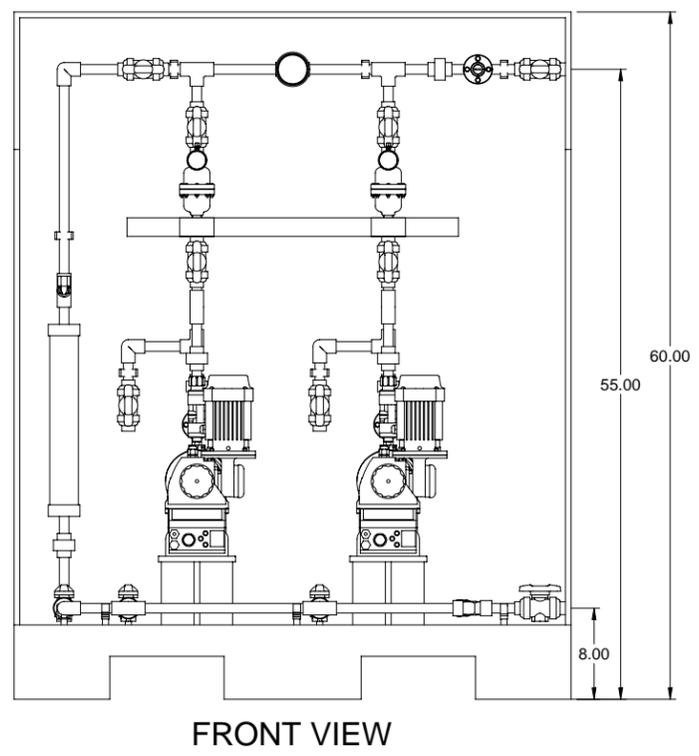

MAXIMUM TESTING PRESSURE =	150 PSI
MAXIMUM OPERATING PRESSURE =	145 PSI
CHEMICAL SERVICE =	

REV	DATE	DESCRIPTION	BY	APPD	REVD
A	05/21/09	REVISED PER BASIC SKID	ALS		
0	03/24/08	FIRST ISSUE	GJS		

REVISIONS

CUSTOMER **PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)**

JOB No **7749410** PURCHASE ORDER No

TITLE **MS2A-A050_FLOOR_PVC/EPDM_PD_FM GENERAL ARRANGEMENT**

THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.

ENGINEERS SEAL	<p>ProMinent[®] THE PROMINENT GROUP OF COMPANIES</p>
PITTSBURGH, PA USA WWW.PROMINENT.US	
PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692 FAX. 519 836 5226	
PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484 FAX. 412 787 0704	
DESIGNED	GJS
DRAWN	GJS
CHECKED	DTH
APPROVED	
SCALE	N.T.S.
DATE	03/24/08