
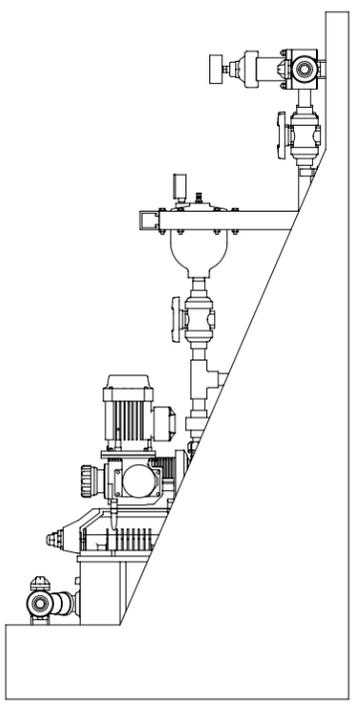


- NOTES:**
- ALL PIPING AND FITTINGS SHALL BE 3/4" SCH. 80 PVC SOCKET WELD WITH EPDM SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
 - ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

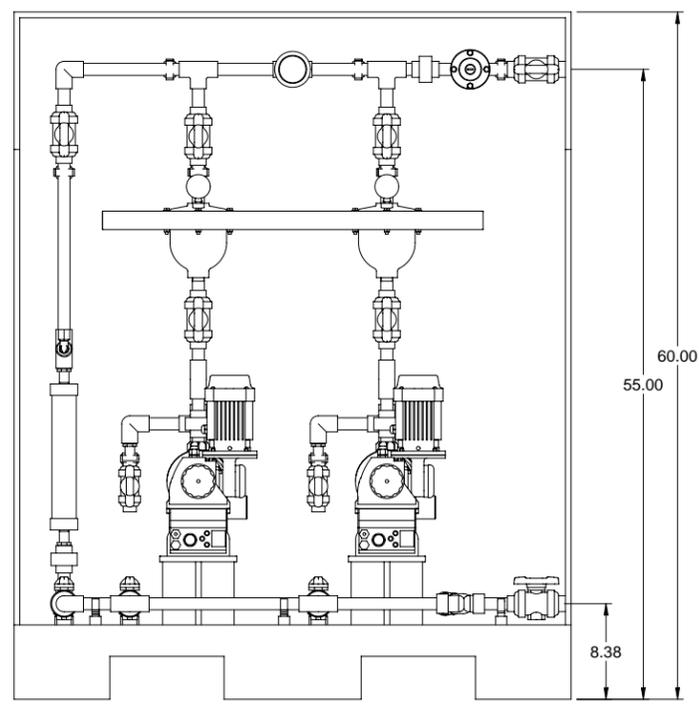

0	03/24/08	FIRST ISSUE	GJS	
REV	DATE	DESCRIPTION	BY	APPD/REV'D
REVISIONS				
CUSTOMER PROMINENT FLUID CONTROLS INC. (PRE-ENGINEERED SYSTEM)				
JOB No 7749419		PURCHASE ORDER No		
TITLE MS2B-A075_FLOOR_PVC/EPDM_PD GENERAL ARRANGEMENT				
THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC.				
ENGINEERS SEAL		 ProMinent [®] THE PROMINENT GROUP OF COMPANIES		
		PITTSBURGH, PA USA WWW.PROMINENT.US		
PROMINENT FLUID CONTROLS LTD. 490 SOUTHGATE DRIVE. GUELPH, ONTARIO, CANADA N1H 6J3 TEL. 519 836 5692 FAX. 519 836 5226		PROMINENT FLUID CONTROLS INC. RIDC PARK WEST 136 INDUSTRY DRIVE, PITTSBURGH P.A., USA. 15275 TEL. 412 787 2484 FAX. 412 787 0704		
DESIGNED	GJS	APPROVED		
DRAWN	GJS	SCALE	N.T.S.	
CHECKED	DTH	DATE	03/24/08	
MAXIMUM TESTING PRESSURE = 150 PSI		DWG No	7749419-200	REV 0 PAGE 1/1
MAXIMUM OPERATING PRESSURE = 102 PSI				
CHEMICAL SERVICE =				