
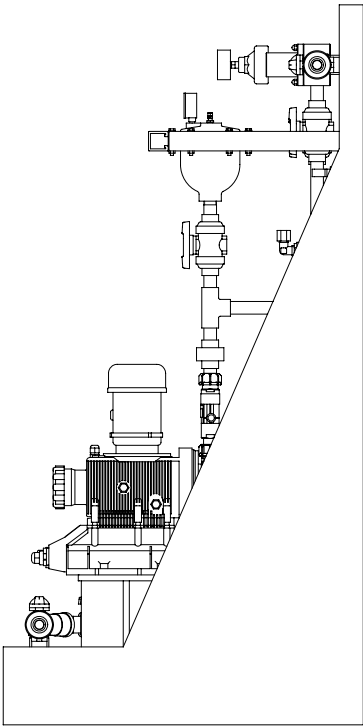
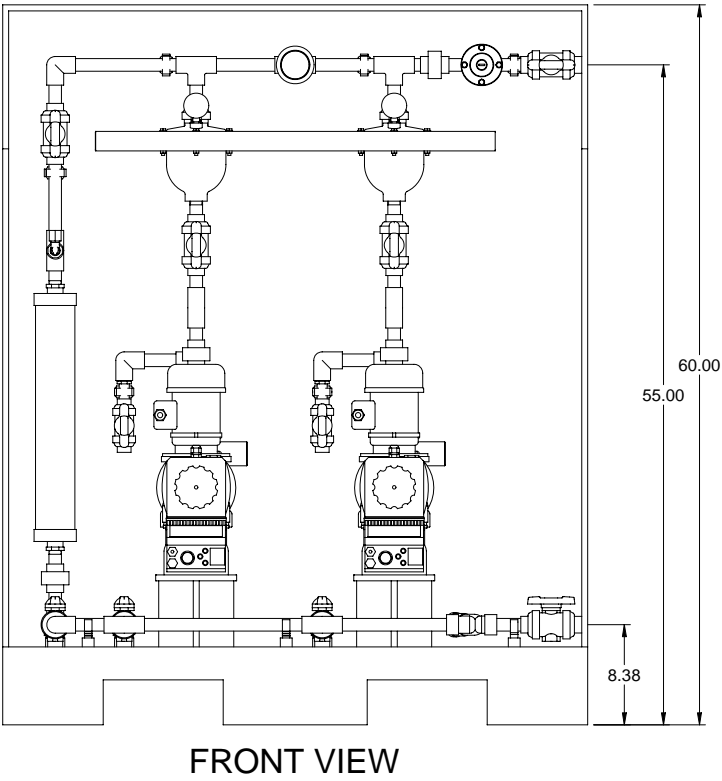


PIPING SCHEMATIC

- NOTES:
- ALL PIPING AND FITTINGS SHALL BE 3/4" SCH. 80 PVC SOCKET WELD WITH EPDM SEALS UNLESS OTHERWISE REQUIRED BY COMPONENTS.
  - ALL DIMENSIONS ARE IN INCHES AND ARE SHOWN FOR REFERENCE ONLY.

|  |          |   |  |                      |          |
|--|----------|---|--|----------------------|----------|
|  |          |   |  |                      |          |
| 0  | 03/24/08 | FIRST ISSUE   |  | GJS                  |          |
| REV  | DATE     | DESCRIPTION   |  | BY                   | APPD/REV |
| REVISIONS  |          |   |  |                      |          |
| CUSTOMER <b>PROMINENT FLUID CONTROLS INC.<br/>(PRE-ENGINEERED SYSTEM)</b>  |          |   |  |                      |          |
| JOB No   |          | 7749422   |  | PURCHASE ORDER No    |          |
| TITLE <b>MS2B-C075_FLOOR_PVC\EPDM_PD_FM<br/>GENERAL ARRANGEMENT</b>  |          |   |  |                      |          |
| THIS DRAWING IS THE PROPERTY OF PROMINENT FLUID CONTROLS INC. AND SHALL NOT BE COPIED OR<br>TRANSFERRED WITHOUT THE WRITTEN CONSENT OF PROMINENT FLUID CONTROLS INC. |          |   |  |                      |          |
| ENGINEERS SEAL   |          | <div><div></div><div><div>ProMinent®</div><div>THE PROMINENT GROUP OF COMPANIES</div></div></div>  |  |                      |          |
|  |          | <div><div><div>PITTSBURGH, PA USA</div><div>PROMINENT FLUID CONTROLS LTD.<br/>490 SOUTHGATE DRIVE.<br/>GUELPH, ONTARIO, CANADA<br/>N1H 6J3<br/>TEL. 519 836 5692      FAX. 519 836 5226</div></div><div><div>WWW.PROMINENT.US</div><div>PROMINENT FLUID CONTROLS INC.<br/>RIDC PARK WEST<br/>136 INDUSTRY DRIVE,<br/>PITTSBURGH P.A., USA. 15275<br/>TEL. 412 787 2484      FAX. 412 787 0704</div></div></div> |  |                      |          |
|  |          | DESIGNED <b>GJS</b>   |  | APPROVED             |          |
|  |          | DRAWN <b>GJS</b>  |  | SCALE <b>N.T.S.</b>  |          |
|  |          | CHECKED <b>DTH</b>  |  | DATE <b>03/24/08</b> |          |
| DWG No   |          |   |  | REV                  | PAGE     |
| 7749422-200  |          |   |  | 0                    | 1/1      |



SIDE VIEW

|                              |         |
|------------------------------|---------|
| MAXIMUM TESTING PRESSURE =   | 150 PSI |
| MAXIMUM OPERATING PRESSURE = | 145 PSI |
| CHEMICAL SERVICE =           |         |